


EN

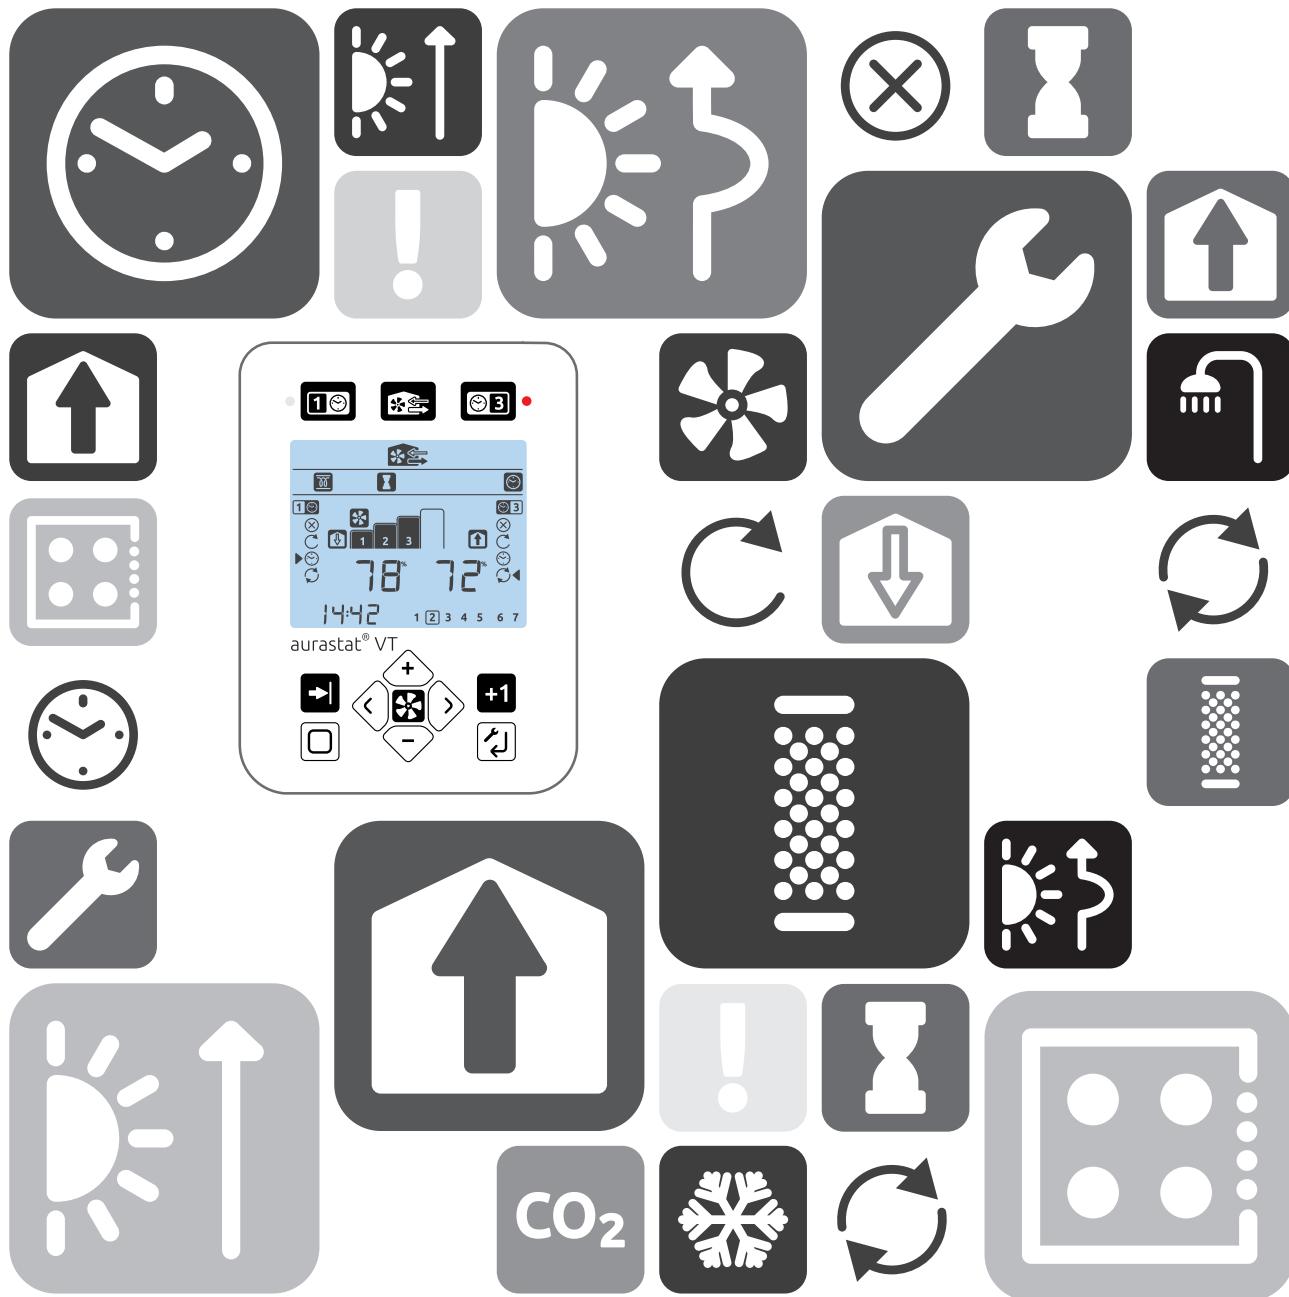

aurastat® VT
TP534

Product Manual

HRV Controller



Warnings, Safety Information and Guidance

Important Information

Important: read these instructions fully before the installation of this appliance

1. This manual covers the operation of the HRV control system only, it must therefore be read in conjunction with the relevant heat recovery unit Product Manual.
2. Installation of the appliance and accessories must be carried out by a qualified and suitable competent person and be carried out in clean, dry conditions where dust and humidity are at minimal levels.
3. All wiring must conform to current I.E.E. Wiring Regulations and all applicable standards and Building Regulations.
4. aurastat®, control & communication cable access to the HRV is via the fitted cable gland(s) which are suitable for Ø3- 6mm cable.
5. aurastat® control & communication cable - Unshielded 4 Core 18-24AWG Stranded, Tinned Copper.
6. Control & communication cables should not be placed within 50mm or on the same metal cable tray as any 230V lighting or power cables.
7. Ensure all cable glands are fully tightened.
8. The unit must be stored in a clean and dry environment. Do not install the appliance in areas where the following may be present or occur;
 - Excessive oil or a grease laden atmosphere,
 - Corrosive or flammable gases, liquids or vapours,
 - Ambient temperatures above 40°C or below -5°C,
 - Humidity levels above 90% or is a wet environment.
9. The appliance is not suitable for installation to the exterior of the dwelling.
10. This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved.
11. Children should be supervised to ensure that they do not play with the appliance.

Warnings, Safety Information and Guidance	Ventilation Commissioning
Important Information	Quick Start Guide..... 11
Product Overview	Setup
Product Description..... 4	Menu Defaults 15
Packaging Contents..... 4	SETUP1 15
Feature Descriptions 4	SETUP2 15
24 Hour Clock 4	SETUP3 18
Day of Week Display 4	RESET4..... 20
Backlight Brightness 4	Timer Setback SPEED1..... 21
Boost Overrun Timer 4	Timer Boost SPEED3..... 21
Boost Delay Timer 4	Installed Configuration..... 22
Boost Inhibit..... 4	SETUP1 22
Internal Humidity Sensor 4	SETUP2 22
Programmable Timers..... 5	SETUP3 22
Filter Change Alert..... 5	Timer Setback SPEED1..... 23
4 x Fan Speeds..... 5	Timer Boost SPEED3..... 23
Fan Speed Display 5	Notes..... 23
Boost Alert 5	
Summer Mode 5	Menu Maps Ventilation
Duct Heater Control..... 5	SETUP1 1 of 2..... 24
SUMMERboost® 5	SETUP1 2 of 2..... 26
Summer By Pass..... 5	SETUP2 1 of 4..... 28
2 x Proportional Sensor Inputs..... 6	SETUP2 2 of 4..... 30
3 x Volt Free Inputs 6	SETUP2 3 of 4..... 32
2 x Live Switch Inputs 6	SETUP2 4 of 4..... 34
Frost Protection Program 6	SETUP3 1 of 2..... 36
Holiday Mode 6	SETUP3 2 of 2..... 38
Multiple Internal Temperature Sensors.... 6	RESET4 1 of 1..... 40
HRV Run Timer 6	
Heating Failure Mode 6	Routine Maintenance
	Cleaning Exterior 41
Installation	Error Codes 41
Fitting	
aurastat® VT 7	
Wiring Connections Access..... 7	Menu Map Timers
aurastat® VT 7	Timer Setback SPEED1 & Boost SPEED2
HRV 7	Setup 1 of 1..... 42
Wiring Diagram 7	
User Interface	
Buttons 8	
Display..... 8	
Display Icons..... 9	
Menu System 9	
Menu Sections 10	




When this document is viewed as a PDF the headings & sub headings on this page are hyperlinks to the content. Additionally the page numbers in this document are hyperlinks back to this contents page.

Product Overview

Product Description

The aurastat® VT is a programmable controller and display for commissioning and monitoring a Titon HRV. The aurastat® VT is connected to the HRV via a wired connection.

Dimensions

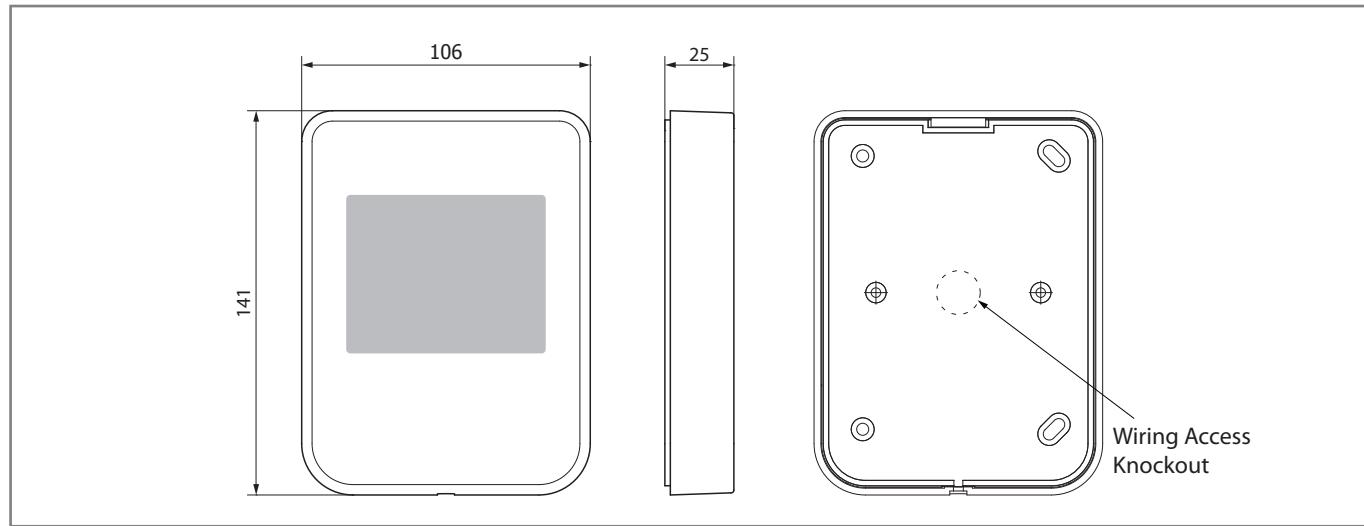

aurastat® VT

Packaging Contents

Inspect the unit when taking delivery. Check the unit for damage and that all accessories have been supplied. Package supplied with:-

- 1 x aurastat® VT controller.
- 1 x cable tie.
- 1 x Product Manual.

Any shortages or damage must be immediately reported to the supplier.

Feature Descriptions

The following gives an outline description for each of the product features.

24 Hour Clock

The aurastat® VT has a twenty four hour clock with a battery backup.

Day of Week Display

The aurastat® VT displays the days of the week as numbers.

Backlight Brightness

The aurastat® VT display backlight brightness can be adjusted or turned off.

Boost Overrun Timer

A programmable timer that controls the time the HRV remains at Boost Speed after all boost switches have been released.

Boost Delay Timer

A programmable timer which can be used to delay the HRV running at Boost Speed after a boost switch has been activated.

Boost Inhibit

A programmed time period that prevents the HRV switching into Boost Speed or -°. Fan speed controlled by proportional inputs are not effected by Boost Inhibit.

Internal Humidity Sensor

The HRV has a relative humidity (RH) sensor, the RH can be displayed on the aurastat® VT LCD screen. The RH sensor can be programmed to switch the HRV into Boost Speed.

Programmable Timers

The aurastat® VT has two 7 day programmable timers that control Setback SPEED1 & Boost SPEED3. Both timers control 3 on/off periods per day. The unit by default runs at Continuous SPEED2. The Programmable Timers are used to Setback or Boost the ventilation rate at specific times. The Timers have 4 modes,

- OFF Timer inactive.
- ONCE Timer active from first ON time to last OFF time.
- AUTO All three time periods are active.
- CONTINUOUS Timer is active regardless of any timed settings.

and 2 override settings.

- ADVANCE Steps the Timer to the next ON or OFF period.
- PLUS ONE Adds 1 hour to a currently active timer, or turns on a one hour timer.

When a timer is active an icon appears in the status area and a red LED is illuminated. If both timers have been set to be active simultaneously Boost SPEED3 takes priority. All other speed controls eg a Boost switch, RH Boost, SUMMERboost® or Frost Protection take priority over the programmable timers.

Filter Change Alert

The aurastat® VT will display an alert after a specified time when the HRV filters require changing.

4 x Fan Speeds

The units have 4 programmable speed settings, all speeds are variable between 14-100% and allow independent speed setting of both supply and extract ventilation rates

1. Setback Speed.
Reduced ventilation.
2. Continuous Speed.
Normal ventilation.
3. Boost Speed.
Increased ventilation
4. SUMMERboost® Speed.
Very high ventilation, only available during Summer By Pass operation.

Fan Speed Display

The aurastat® VT screen displays the selected fan speed using the 1-4 stepped icons.

SUMMERboost®

SUMMERboost® allows both the supply and extract fans to run at full speed whenever the Summer Bypass is activated. By default SUMMERboost® is enabled. When SUMMERboost® is triggered by Summer Bypass the increased fan speed can be prevented either Manually or Automatically. Manual - This is by means of a volt-free switch wired directly into the controller PCB.

Automatic - This is by means of a dedicated wall mounted room thermostat. SUMMERboost® will only operate when the temperature has exceeded the thermostat setting. Should the room temperature fall below the thermostat setting, then SUMMERboost® will not operate.

Summer By Pass

Summer Bypass is designed to operate during hot periods where fresh air can be vented straight into the property without being preheated by the extracted stale air. Summer Bypass operation is automatically controlled. The Summer Bypass mechanism diverts the stale air being extracted from the dwelling around the heat cell so that its heat energy is not transferred to the fresh air being supplied to the dwelling.

Continued....

Boost Alert

A programmable timer which displays a warning message on the aurastat® VT LCD screen after the HRV has been left in Boost Speed for the specified time.

Summer Mode

Summer Mode operates by slowing or stopping the supply fan. This reduces the supply of From Atmosphere air to the dwelling. Summer Mode is triggered automatically or via a Volt Free input. Summer Mode must not be enabled or installed in dwellings where open flue combustion appliances are used.

Duct Heater Control

To maintain ventilation flow rates where prolonged periods of very low temperatures occur, the facility for the control of an electrically powered Duct Heater is provided, MAX 1800W. The Duct Heater is placed in-line between the outside supply vent and the From Atmosphere terminal on the HRV. In these applications, the heater is used to pre-warm the outside fresh air supply before it enters the HRV.

Continued....

2 x Proportional Sensor Inputs

Enables connection of environmental sensors to the HRV which can be used to proportionally control HRV fan speeds.

3 x Volt Free Inputs

Enables the connection of single pole momentary switches, latching switches or normally open relay contacts to the HRV. These can be used to switch between fan speeds or control SUMMERboost® and Summer Mode.

2 x Live Switch Inputs

These inputs are used to switch the HRV to Boost Speed via a switched live input.

Frost Protection Program

During very cold weather, the Frost Protection Program will detect temperatures that could cause ice to form inside the unit. It will reduce or stop the supply ventilation rate, thus allowing the warmer stale air to raise the temperature within the unit cell to such a level that prevents the formation of ice. As temperatures rise the Frost Protection Program will increase the supply ventilation flow rate back to the commissioned settings.

Holiday Mode

The aurastat® VT can set the HRV to Holiday Mode. Holiday Mode sets the HRV to speed 1 Setback Speed, Boost Inhibit is enabled.

Multiple Internal Temperature Sensors

The aurastat® VT LCD can display the From Atmosphere and To Atmosphere air temperatures in real-time. Additionally the temperature of the heat cell is monitored.

HRV Run Timer

The aurastat® VT displays the total run time of the unit in hours.

Heating Failure Mode

This feature stops all ventilation and overrides any other speed control input when the air extracted from the dwelling is below 5°C. The Frost Program icon will flash and the fan speeds will display 0%.

The unit will remain off until the Fan Key is pressed or the temperature increases above 5°C.

When the Fan Key is pressed the unit will restart at full speed and settle back to normal operation after approximately 40 seconds. If the air extracted from the dwelling is still below 5°C Heating Failure Mode will stop the ventilation again. Heating Failure Mode does not prevent the unit running during commissioning in Setup Menu 3.

Fitting

aurastat® VT

The unit is designed to be wall mounted or fitted over a UK standard single gang recessed metal box. It should be sited in a place that is visible and convenient for the householder. To fit the unit, first remove the front of the unit; The front of the unit is removed by loosening a single screw on the bottom face to the unit, lifting the bottom of the front away from the base and unhooking the top of the front from the base. Fix base to the wall (always use a fixing suited to the wall type) or if using a metal box using M3.5 raised countersunk machine screws.

Wiring Connections Access


aurastat® VT

The front of the unit is removed by loosening a single screw on the bottom face to the unit, lifting the bottom of the front away from the base and unhooking the top of the front from the base. The base has a cable access knockout. Communication Cable - Unshielded 4 Core 18-24AWG Stranded, Tinned Copper must be zip tied to the loop provided on the front cover. The wiring connections are mounted on the circuit board in the front of the unit.

HRV

Refer to the Product Manual for the specific unit for information.

Wiring Diagram

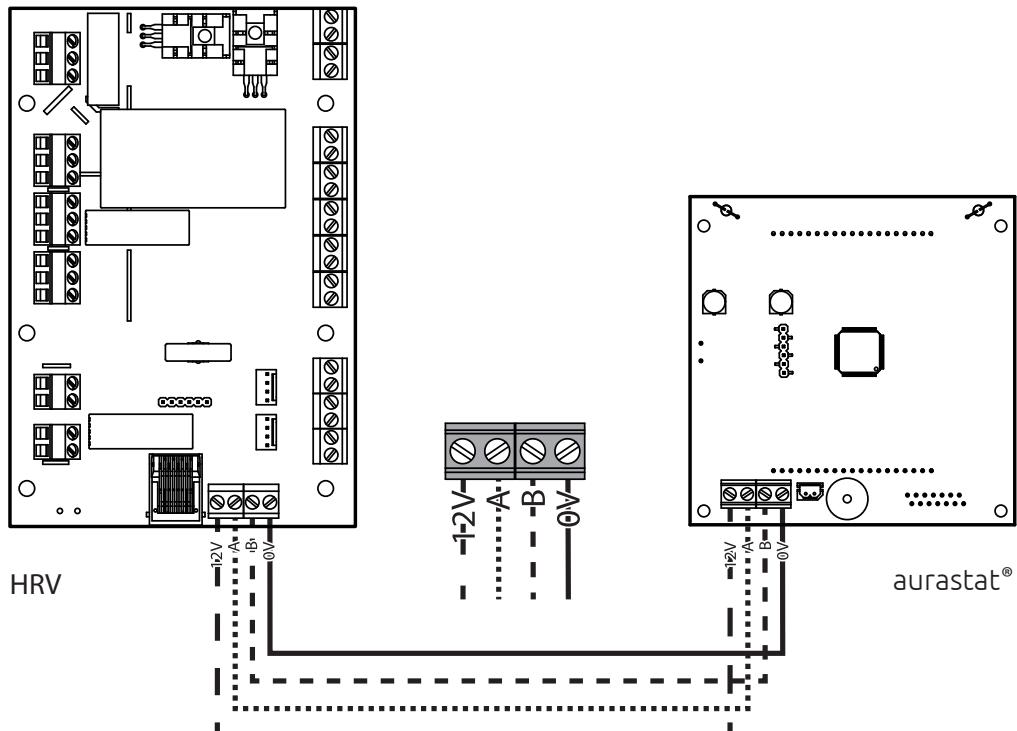

aurastat® VT to HRV connection wiring

User Interface

The aurastat® VT provides the user interface for commissioning and monitoring of a Titon HRV.


Buttons

The aurastat® VT has twelve buttons which control, configure and monitor the HRV. The Buttons on the units have different function depending on which mode the units is in and which menu is active.

Run Modes		
 Setback SPEED 1 Timer	 Ventilation	 Boost SPEED 3 Timer
Run Modes		
Enter setup	 SETUP key	SETUP Menus
Switch between Fan Speed % display & Temperature monitoring	 ARROW keys	Enter menu item Enter parameter setting
Changes Timer mode	 +/- keys	Previous / Next menu item Navigation
Cycle through Clock, RH% & Room Sensor(s) Long Press engage Holiday Mode	 HOME key	Increase / Decrease parameter
Switch HRV into Speed 3 Boost Speed Restart - Heating Failure Mode	 FAN key	Back to Setup Menu
Advance timer program when unit is in Timer Mode	 Advance key	
Adds one hour of Timer run time to the selected Timer Mode	 +1 Plus one key	

Display

The display is a 90mm liquid crystal display (LCD) screen. The display has a back light. The display uses a mixture of icons text and figures grouped into regions to communicate information to the user.

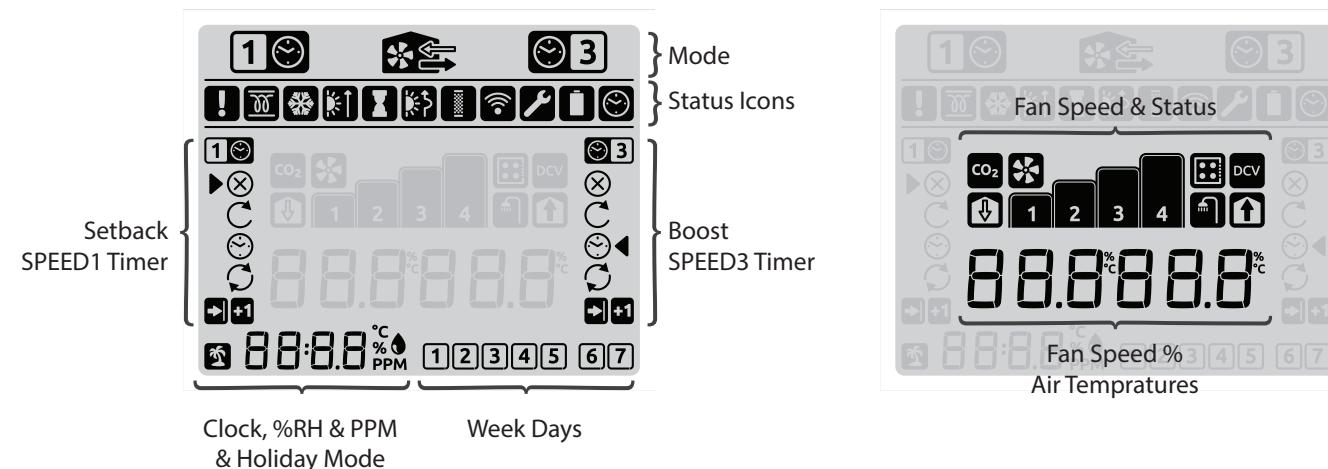

Display Icons

Icon definitions

Status

	Alert		Filter Alert
	Duct Heater		Set Up
	Frost Program active		
	Summer Mode active		Timer active
	Boost Timer		
	Summer By Pass active		Timer OFF
	Holiday Mode active		Timer ONCE
			Timer AUTO
	CO ₂ Sensor		Timer CONTINUOUS
	Demand Control Ventilation		
	Kitchen		Advance active
	Wet Room		Plus one hour active
	Fan		
	Supply		
	Extract		

Menu System

The aurastat® VT menu system is divided into three modes, one ventilation mode which has five sections and two timer modes. This is to make the display user friendly for both the end user (householder) and the service / installation engineer.

Menu	MODES						Setback SPEED1 Timer	Boost SPEED3 Timer
	Ventilation Mode							
Monitor & Control RUN Menu		User setup	Service & Setup	Commissioning & Installation	Reset			
Name displayed		SETUP 1	SETUP 2	SETUP 3	RESET 4		Gives access to the settings to control the timings of Setback SPEED1	Gives access to the settings to control the timings of Boost SPEED3
Description	Gives access to the control and monitoring functions.	Gives access to settings likely to be routinely used by the householder.	Gives access to settings likely to be used by Maintenance or Service Engineers.	Gives access to advanced settings required during installation and commissioning. Pass code protected.	Gives access to the reset function. Pass code protected.			

Menu Sections

The table below gives an overview of which item and settings are in which Mode and menu section.

Menu item	MODES				
	Ventilation Modes				Timer Modes
	User setup	Service & Setup	Commissioning & Installation	Reset	Timer Setup
	SETUP 1	SETUP 2	SETUP 3	RESET 4	
Time	o				o
Day of Week	o				o
Timers					o
Backlight Brightness	o				
Boost Overrun Timer	o	o	o		
Boost Delay Timer	o	o	o		
Boost Inhibit On/Off	o				
Boost Inhibit Times	o				
Internal Humidity Boost (Set Point)	o				
Run Timer		o			
Filter Change Reset		o			
Filter Change Interval		o			
Speed 4 SUMMERboost®		o	o		
Boost Alert On/Off		o			
Boost Alert Timer		o			
Summer Mode Enable/Disable		o			
Summer Mode		o			
Summer By Pass Enable/Disable		o			
Summer By Pass		o			
Duct Heater Enable/Disable		o			
Duct Heater		o			
Room Sensor 1 - Set Points		o			
Room Sensor 2 - Set Points		o			
Internal Humidity Boost On/Off		o			
Internal Humidity Boost (Full)		o			
Contious SPEED 2			o		
Boost SPEED 3			o		
Setback SPEED 1			o		
Frost Protection			o		
Room Sensor 1 Enable/Disable			o		
Room Senor 1 - Configuration			o		
Room Sensor 2 Enable/Disable			o		
Room Senor 2 - Configuration			o		
Switch input 1			o		
Switch input 2			o		
Switch input 3			o		
Live Switch 1 (LS1)			o		
Live Switch 2 (LS2)			o		
Reset				o	

Ventilation Commissioning


Quick Start Guide

Titon recommend that every installer start with the with the Quick Start Guide as a menu familiarization exercise. Using the Quick Start Guide installers can setup the HRV quickly. With the minimum of configuration changes the system will be up and running. All other settings are set at the default settings, fine tuning can be carried out at any time.

The Quick Start Guide explains step by step how to set up.

1. Time.
2. Day.
3. Continuous Speed 1.
4. Boost Speed 3.

SETUP Menus












Enter menu item
Enter parameter setting

Previous / Next menu item
Navigation


Increase / Decrease parameter






Back to Setup Menu







Step	Action	Button Press(es)	Screen(s)
1	Power up the HRV Run Mode		
2	Enter SETUP	Press key	
3	Enter SETUP1 menu	Press key	

Step	Action	Button Press(es)	Screen(s)
4	Enter Clock setup	Press  key, to enter clock edit	
5	Edit minutes	Using  /  keys to edit mins value Press  key, to enter mins and move to next menu item	
6	Edit Hours	Using  /  edit hours value Press  key, to enter hours and move to next menu item	
7	Enter Day setup	Press  key, to enter day setup	
8	Change Day	Using  /  edit day Press  key, to enter Day and move to next menu item	
9	Exit SETUP1 menu	Press  key, to return to SETUP1 menu	 
10	Enter SETUP3 menu	Move to SETUP3 menu by pressing  key twice Press  key to enter SETUP3 menu	 
11	Enter Pass Code	Using  /  edit the individual digits. Use  /  to move digits. Press  key, Enter Pass Code 3333	

SETUP Menus

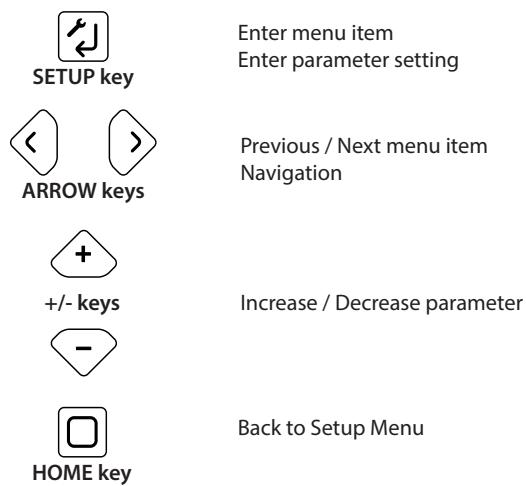

Step	Action	Button Press(es)	Screen(s)
12	Enter Continuous SPEED2 setup	Press  key to enter edit	 
13	Edit Continuous Supply Rate	Using  edit supply rate Press and release to modify the decimal Press and hold to modify the integer Press  key, to enter value and move to next menu item	
14	Edit Continuous Extract Rate	Using  edit extract rate Press and release to modify the decimal Press and hold to modify the integer Press  key, to enter value and move to DONE	
15	Finish Continuous SPEED2 setup	Press  key to enter values and move to the next menu item	 

Step	Action	Button Press(es)	Screen(s)
16	Enter Boost SPEED3 setup	Press  key to enter edit	 
17	Edit Boost Supply Rate	Using  /  edit supply rate Press and release to modify the decimal Press and hold to modify the integer Press  key, to enter value and move to next menu item	
18	Edit Boost Extract Rate	Using  /  edit extract rate Press and release to modify the decimal Press and hold to modify the integer Press  key, to enter value and move to DONE	
19	Exit SETUP3	Press  key to enter values and move to the next menu item. Press  key twice to exit SETUP3 menu and return to Run Mode	 
20	Run Mode		

Menu Defaults

The tables below detail the default values and the range of available settings, plus any additional information about the unit's configurable settings.

SETUP1

Configurable Item		Range		Default	Additional information
		Min	Max		
Time		Any Time		00:00	24 hour clock.
Day of Week		1	7	1	Two groups, five week days & two weekend days.
Backlight Brightness		Off	4	1	Off, 25%, 50%, 75% & 100%
Boost Overrun	Kitchen	0 mins	60 mins	15 mins	
	Wet Room	0 mins	60 mins	15 mins	
Boost Overrun timers are set independently for Kitchen and Wet Room inputs.					
Boost Overrun timers must be set greater than zero for any momentary switch or the aurastat's fan button to trigger boost.					
The aurastat's fan button uses the Kitchen Boost Overrun timer.					
When using latching switches to initiate Boost SPEED 3 the Overrun timer will start when the latching switch is disengaged.					
Boost Delay Timer		0 mins	60 mins	0 mins	
If the Boost Delay Timer is set greater than zero momentary switches or the aurastat's fan button will not switch the HRV into Boost SPEED 3. When using latching switches, if the Boost switch is turned off before the Boost Delay Timer has elapsed the HRV will not Boost.					
Boost Inhibit On/Off		On	Off	Off	
Boost Inhibit Times	Start	00:00	23:59	23:00	
	End	00:00	23:59	05:00	
Internal Humidity Boost (Setpoint)		30%	89%	70%	

SETUP2

Configurable Item		Range		Default	Additional information
		Min	Max		
Filter Change Interval		3 months		24 months	12 months
Boost Overrun Timer	Kitchen	0 mins	60 mins	15 mins	
	Wet Room	0 mins	60 mins	15 mins	
Boost Overrun timers are set independently for Kitchen and Wet Room inputs.					
Boost Overrun timers must be set greater than zero for any momentary switch or the aurastat's fan button to trigger boost.					
The aurastat's fan button uses the Kitchen Boost Overrun timer.					
When using latching switches to initiate Boost SPEED 3 the Overrun timer will start when the latching switch is disengaged.					
Boost Delay Timer		0 mins	60 mins	0 mins	
If the Boost Delay Timer is set greater than zero momentary switches or the aurastat's fan button will not switch the HRV into Boost SPEED 3. When using latching switches, if the Boost switch is turned off before the Boost Delay Timer has elapsed the HRV will not Boost.					
Speed 4 SUMMERboost®		14%	100%	100%	SUMMERboost® is only available on models with Summer. SUMMERboost® is disabled by default.
Press and release the + / - key to modify the mantissa(decimal). Press and hold the + / - key to modify the characteristic (integer). HRV fan speed will change to reflect the displayed setting when the button is released. Changes in fan speed will take time to be reflected as changes to the ventilation system airflow rates. Fan speed will not change while in this configuration menu.					
Boost Alert On/Off		On	Off	On	
Boost Alert Timer		1 hour	10 hours	2 hours	

Configurable Item		Range		Default	Additional information
		Min	Max		
Summer Mode Enable/Disable		Enabled	Disabled	Enabled	Disabled in By Pass unit.
Summer Mode	Extract from dwelling	17°C	35°C	22°C	
	Supply to dwelling	15°C	20°C	18°C	
	Supply Fan Speed	0%	100%	0%	
<p>The Summer Mode fan speed is a % of Continuous SPEED 2. Therefore care must be taken to set the Summer Mode fan speed at a value that makes the actual fan speed greater than 14%.</p> <p>e.g. Continuous SPEED 2 x Summer Mode fan speed = Actual fan speed. $50\% \times 50\% = 25\%$, $50\% \times 28\% = 14\%$.</p> <p>If the actual fan speed between 1% & 14% the fan may not run and an Error will be shown.</p>					
Summer By Pass Enable/Disable		Enabled	Disabled	Enabled	Enabled in By Pass unit
Summer By Pass	Extract from dwelling	17°C	35°C	25°C	<p>In order for the Summer By Pass to operate the temperatures of both the air being extracted from and supplied to the property must be above their individual thresholds. If the temperature of the Supply air exceeds that of the Extracted air the Summer By Pass switches off to prevent the warmer air being supplied directly to the property.</p>
	Supply to dwelling	10°C	20°C	18°C	
SUMMERboost®		Enabled	Disabled	Enabled	
Duct Heater Enable/Disable		Enabled	Disabled	Disabled	
Duct Heater		Frost	User	Frost	<p>Selects sensor that controls Duct Heater activity.</p> <p>Frost (FRST) = Uses sensor on the to atmosphere side of the heat cell and the Frost Protection Threshold temperature configured in SETUP3.</p> <p>User = Uses sensor in the From Atmosphere (OUTSIDE) airstream and user configured Duct Heater threshold temperature.</p>
Hyst		1°C	10°C	1°C	Hysteresis value used during rising temperature scenarios to prevent rapid switching of the Duct Heater.
Duct Heater threshold		-4°C	16°C	4°C	Temperature at which duct heater will turn on. This setting is only used in User mode.
<p>Frost mode:</p> <p>During falling temperature scenarios duct heater will switch on at Frost threshold + 2°C switch off at the Frost Threshold.</p> <p>During rising temperature scenarios duct heater will remain switched on between Frost threshold and Frost threshold + 2°C + Hysteresis °C.</p> <p>User mode:</p> <p>During falling temperature scenarios duct heater will switch on below Duct Heater threshold.</p> <p>During rising temperature scenarios duct heater will switch off above Duct Heater threshold + Hysteresis °C.</p> <p>If the supply fan is set to run at a speed less than 25% Duct Heater will not turn on. This can be either by a configured speed eg Setback SPEED1, holiday mode or Frost protection being active).</p>					


Configurable Item		Range		Default	Additional information																				
		Min	Max																						
Room Sensor 1		na	na	%RH	<p>These settings are only available when Room Sensor1 is enabled in SETUP3 menu.</p> <p>Room Sensor 1 is setup by default for use with an %RH sensor.</p> <p>Room sensor can be configured to also operate with;</p> <ul style="list-style-type: none"> o Air Quality (AQ) Sensor - PPM, o CO2 Sensor - PPM CO₂, o Temperature Sensor - °C. 																				
<p>Continuous SPEED 2 Proportional Increase Boost SPEED 3</p> <p>0000 20 60 70 90 9999</p> <p>Sensor Min Point 0V Set Point Low Set Point High Sensor Max Point 10V</p>																									
Set point Low		Dynamic	Dynamic	60%	<p>Sensor Min & Max values are setup in SETUP3 menu</p> <p>Recommended Default High & Low Values for sensors</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <th>Sensor Type</th> <th>Titon Part №</th> <th>SP Low</th> <th>SP high</th> </tr> <tr> <td>°C</td> <td>TP543</td> <td>0017</td> <td>0027</td> </tr> <tr> <td>CO₂ PPM</td> <td>TP541</td> <td>0800</td> <td>1400</td> </tr> <tr> <td>AQ PPM</td> <td>TP540</td> <td>0800</td> <td>1400</td> </tr> <tr> <td>%RH</td> <td>TP542</td> <td>0060</td> <td>0070</td> </tr> </table>	Sensor Type	Titon Part №	SP Low	SP high	°C	TP543	0017	0027	CO ₂ PPM	TP541	0800	1400	AQ PPM	TP540	0800	1400	%RH	TP542	0060	0070
Sensor Type	Titon Part №	SP Low	SP high																						
°C	TP543	0017	0027																						
CO ₂ PPM	TP541	0800	1400																						
AQ PPM	TP540	0800	1400																						
%RH	TP542	0060	0070																						
Set point High		Dynamic	Dynamic	70%																					
Room Sensor 2		na	na	CO ₂	<p>These settings are only available when Room Sensor2 is enabled in SETUP3 menu.</p> <p>Room Sensor 2 is setup by default for use with an CO₂ sensor.</p> <p>Room sensor can be configured to also operate with;</p> <ul style="list-style-type: none"> o Temperature Sensor - °C. o Air Quality (AQ) Sensor - PPM, o Humidity Sensor - %RH 																				
<p>Continuous SPEED 2 Proportional Increase Boost SPEED 3</p> <p>0000 450 800 1400 1850 9999</p> <p>Sensor Min Point 0V Set Point Low Set Point High Sensor Max Point 10V</p>																									

Configurable Item		Range		Default	Additional information																				
		Min	Max																						
Set point Low		Dynamic	Dynamic	800PPM	<p>Sensor Min & Max values are setup in SETUP3 menu</p> <p>Recommended Default High & Low Values for sensors</p> <table border="1"> <thead> <tr> <th>Sensor Type</th> <th>Titon Part №</th> <th>SP Low</th> <th>SP high</th> </tr> </thead> <tbody> <tr> <td>°C</td> <td>TP543</td> <td>0017</td> <td>0027</td> </tr> <tr> <td>CO₂ PPM</td> <td>TP541</td> <td>0800</td> <td>1400</td> </tr> <tr> <td>AQ PPM</td> <td>TP540</td> <td>0800</td> <td>1400</td> </tr> <tr> <td>%RH</td> <td>TP542</td> <td>0060</td> <td>0070</td> </tr> </tbody> </table>	Sensor Type	Titon Part №	SP Low	SP high	°C	TP543	0017	0027	CO ₂ PPM	TP541	0800	1400	AQ PPM	TP540	0800	1400	%RH	TP542	0060	0070
Sensor Type	Titon Part №	SP Low	SP high																						
°C	TP543	0017	0027																						
CO ₂ PPM	TP541	0800	1400																						
AQ PPM	TP540	0800	1400																						
%RH	TP542	0060	0070																						
Set point High		Dynamic	Dynamic	1400PPM																					
Internal Humidity Boost		On	Off	Off																					
Internal Humidity %RH Boost FULL																									
%RH Boost Set point		30%	89%	70%	HRV will switch to Boost SPEED 3 when %RH is greater than set point value.																				
%RH Boost Overrun timer		1 min	60 mins	15 mins	The timer is engaged when the %RH has decreased to the %RH set point less the %RH Boost Hysteresis.																				
%RH Boost Hysteresis		1%	10%	1%																					
<p>During falling humidity scenarios the HRV will remain in Boost SPEED 3 until the %RH has decreased to below %RH set point less %RH Boost Hysteresis and the % RH Boost Overrun timer has elapsed.</p> <p>When the timer is in operation the hour glass symbol is displayed.</p>																									

SETUP3

Configurable Item		Range		Default	Additional information
		Min	Max		
SETUP3 pass code		na	na	3333	Pass code needs to be entered to configure settings in the SETUP3 menu
Continuous SPEED2	Supply	14%	100%	40%	
	Extract	14%	100%	40%	
Boost SPEED3	Supply	14%	100%	70%	
	Extract	14%	100%	70%	
Setback SPEED1	Supply	14%	100%	18%	
	Extract	14%	100%	18%	
<p>Press and release the + / - key to modify the mantissa (decimal).</p> <p>Press and hold the + / - key to modify the characteristic (integer)</p> <p>HRV fan speed will change to reflect the displayed setting when the button is released. Changes in fan speed will take time to be reflected as changes to the ventilation system airflow rates.</p>					
Boost Overrun	Kitchen	0 mins	60 mins	15 mins	
	Wet Room	0 mins	60 mins	15 mins	
<p>Boost Overrun timers are set independently for Kitchen and Wet Room inputs.</p> <p>Boost Overrun timers must be set greater than zero for any momentary switch or the aurastat fan button to trigger boost.</p> <p>The aurastat's fan button uses the Kitchen Boost Overrun timer. When using latching switches to initiate Boost SPEED 3 the Overrun timer will start when the latching switch is disengaged.</p>					
Boost Delay Timer		0 mins	60 mins	0 mins	
<p>If the Boost Delay Timer is set greater than zero momentary switches of the aurastat's fan button will not switch the HRV into Boost SPEED 3. When using latching switches, if the Boost switch is turned off before the Boost Delay Timer has elapsed the HRV will not Boost.</p>					

Configurable Item		Range		Default	Additional information																				
		Min	Max																						
SPEED4 SUMMERboost®		14%	100%	100%	SUMMERboost® is only available on models with Summer By Pass. SUMMERboost® is enabled by default.																				
Press and release the + / - key to modify the mantissa. Press and hold the + / - key to modify the characteristic (integer). HRV fan speed will change to reflect the displayed setting when the button is released. Changes in fan speed will take time to be reflected as changes to the ventilation system airflow rates.																									
Frost set point		-2°C	11.5°C	2°C																					
Press and release the + / - key to modify the mantissa. Press and hold the + / - key to modify the characteristic (integer)																									
Frost Protection Mode		Off	Reduce	Off																					
Off = When temperature detected is below Frost set point Frost Protection activates turning off the Supply fan. Reduce = When temperature detected is below Frost set point Frost Protection activates, progressively reducing the speed of the Supply fan until the temperature reaches 4°C below Frost set point at which point the Supply fan is stopped.																									
Room Sensor 1 Enable/Disable		Enable	Disable	Disable	Activates Setup Room Sensor 1 in SETUP2 menu.																				
Room Sensor Type				%RH	Options are; Temperature Sensor - °C, CO ₂ Sensor - PPM, Air Quality Sensor - PPM, Humidity Sensor - %RH.																				
Sensor Min Point 0V		0	9999	20%																					
Sensor Max Point 10V		0	9999	90%	Settings required for Titon supplied sensors: <table border="1"> <tr> <th>Sensor Type</th> <th>Titon Part №</th> <th>Min 0V</th> <th>Max 10V</th> </tr> <tr> <td>°C</td> <td>TP543</td> <td>0000</td> <td>0040</td> </tr> <tr> <td>CO₂ PPM</td> <td>TP541</td> <td>0450</td> <td>1850</td> </tr> <tr> <td>AQ PPM</td> <td>TP540</td> <td>0450</td> <td>1850</td> </tr> <tr> <td>%RH</td> <td>TP542</td> <td>0020</td> <td>0090</td> </tr> </table> Consult manufactures data sheets for details.	Sensor Type	Titon Part №	Min 0V	Max 10V	°C	TP543	0000	0040	CO ₂ PPM	TP541	0450	1850	AQ PPM	TP540	0450	1850	%RH	TP542	0020	0090
Sensor Type	Titon Part №	Min 0V	Max 10V																						
°C	TP543	0000	0040																						
CO ₂ PPM	TP541	0450	1850																						
AQ PPM	TP540	0450	1850																						
%RH	TP542	0020	0090																						

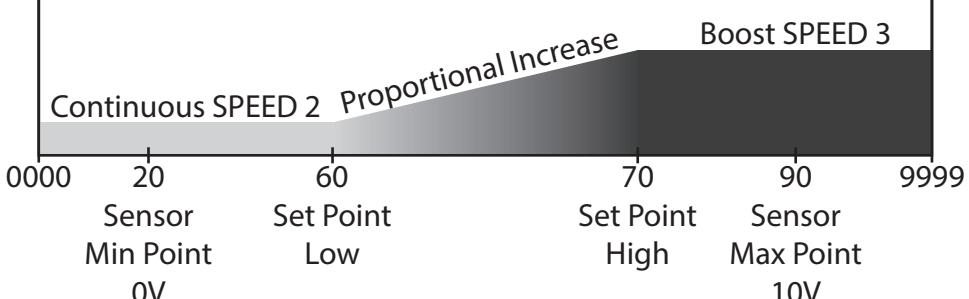

Configurable Item		Range		Default	Additional information																				
		Min	Max																						
Room Sensor 2 Enable/Disable		Enable	Disable	Disable	Activates Setup Room Sensor 1 in SETUP2 menu.																				
Room Sensor Type				CO ₂	Options are; Temperature Sensor - °C, CO ₂ Sensor - PPM, Air Quality Sensor - PPM, Humidity Sensor - %RH.																				
Sensor Min Point 0V		0	9999	450PPM	Settings required for Titon supplied sensors: <table border="1" data-bbox="1101 662 1497 891"> <tr> <th>Sensor Type</th> <th>Titon Part №</th> <th>Min 0V</th> <th>Max 10V</th> </tr> <tr> <td>°C</td> <td>TP543</td> <td>0000</td> <td>0040</td> </tr> <tr> <td>CO₂ PPM</td> <td>TP541</td> <td>0450</td> <td>1850</td> </tr> <tr> <td>AQ PPM</td> <td>TP540</td> <td>0450</td> <td>1850</td> </tr> <tr> <td>%RH</td> <td>TP542</td> <td>0020</td> <td>0090</td> </tr> </table> Consult manufactures data sheets for details.	Sensor Type	Titon Part №	Min 0V	Max 10V	°C	TP543	0000	0040	CO ₂ PPM	TP541	0450	1850	AQ PPM	TP540	0450	1850	%RH	TP542	0020	0090
Sensor Type	Titon Part №	Min 0V	Max 10V																						
°C	TP543	0000	0040																						
CO ₂ PPM	TP541	0450	1850																						
AQ PPM	TP540	0450	1850																						
%RH	TP542	0020	0090																						
Sensor Max Point 10V		0	9999	1850PPM																					
<p>Continuous SPEED 2 Proportional Increase Boost SPEED 3</p> <p>0000 450 800 1400 1850 9999</p> <p>Sensor Set Point Set Point Sensor Max Point</p> <p>Min Point Low High 10V</p>																									
Switch Input 1				Boost from Kitchen	Options are; Boost from Kitchen,																				
Switch Input 2				Boost from Wet Room	Boost from Wet Room, Setback,																				
Switch Input 3				Summer Mode Engage / SUMMERboost® Disable.	Summer Mode Engage / SUMMERboost® Disable.																				
Live Switch 1 (LS1)				Boost from Kitchen	Options are; Boost from Kitchen,																				
Live Switch 2 (LS2)				Boost from Wet Room	Boost from Wet Room.																				

RESET4

Configurable Item		Range		Default	Additional information
		Min	Max		
Passcode				6840	
Reset		Yes	No	No	Selecting Yes returns ALL configurable values except commissioned fan speeds to the preceding default values and returns to SETUP1 menu.

Timer Setback SPEED1

Configurable Item		Range		Default	Additional information
		Min	Max		
Days 1 to 5	On 1	00:00	24:00	00:00	On or Off times are set for the current day in increments of 5 minutes. An On time cannot be set earlier than the previous Off time. An Off time cannot be set earlier than the associated On time.
	Off 1	00:00	24:00	06:00	
	On 2	00:00	24:00	12:00	
	Off 2	00:00	24:00	12:00	
	On 3	00:00	24:00	23:00	
	Off 3	00:00	24:00	00:00	
Days 6 & 7	On 1	00:00	24:00	00:00	
	Off 1	00:00	24:00	06:30	
	On 2	00:00	24:00	12:00	
	Off 2	00:00	24:00	12:00	
	On 3	00:00	24:00	23:00	
	Off 3	00:00	24:00	00:00	

Timer Boost SPEED3

Configurable Item		Range		Default	Additional information
		Min	Max		
Days 1 to 5	On 1	00:00	24:00	07:00	On or Off times are set for the current day in increments of 5 minutes. An On time cannot be set earlier than the previous Off time. An Off time cannot be set earlier than the associated On time.
	Off 1	00:00	24:00	08:00	
	On 2	00:00	24:00	12:00	
	Off 2	00:00	24:00	12:00	
	On 3	00:00	24:00	18:00	
	Off 3	00:00	24:00	19:00	
Days 6 & 7	On 1	00:00	24:00	08:00	
	Off 1	00:00	24:00	09:00	
	On 2	00:00	24:00	12:00	
	Off 2	00:00	24:00	12:00	
	On 3	00:00	24:00	18:00	
	Off 3	00:00	24:00	19:00	

Installed Configuration.

The Tables below MUST be completed by the installer with all configured setting that deviate from the defaults.
Default values shown greyed out.

SETUP1

Configurable Item		Setting
Backlight Brightness		One
Boost Overrun	Kitchen	15 mins
	Wet Room	15 mins
Boost Delay Timer	Kitchen	0 mins
	Wet Room	0 mins
Boost Inhibit On/Off		Off
Boost Inhibit Times	Start	23:00
	End	05:00
%RH Boost Set point		70 %

Configurable Item		Default
Room Sensor 1		
Set point Low		0060
Set point High		0070
Room Sensor 2		
Set point Low		0800
Set point High		1400
Internal Humidity Boost		Off
%RH Boost Overrun timer		15 %
%RH Boost Hysteresis		1 %

SETUP2

Configurable Item		Default
Filter Change Interval		12 months
Boost Overrun Timer	Kitchen	15 mins
	Wet Room	15 mins
Boost Delay Timer		0 mins
Speed 4 SUMMERboost®	Supply	100 %
	Extract	100 %
Boost Alert On/Off		On
Boost Alert Timer		2 hours
Summer Mode Enable/Disable		Disable
Summer Mode	Extract	22 °C
	Supply	18 °C
	Supply Fan Speed	0 %
Summer By Pass Enable/Disable		Enable
Summer By Pass	Extract	25 °C
	Supply	18 °C
SUMMERboost®		Enable
Duct Heater Enable/Disable		Disable
Duct Heater		Frost
Hyst		1 °C
Duct Heater threshold		4 °C

SETUP3

Configurable Item		Default
Continuous SPEED2	Supply	40 %
	Extract	40 %
Boost SPEED3	Supply	70 %
	Extract	70 %
Setback SPEED1	Supply	18 %
	Extract	18 %
SPEED4 SUMMERboost®	Supply	100 %
	Extract	100 %
Frost set point		2 °C
Frost Protection Mode		Off
Room Sensor 1 Enable/Disable		Disable
Room Sensor Type		%RH
Sensor Min Point 0V		0020
Sensor Max Point 10V		0090
Room Sensor 2 Enable/Disable		Disable
Room Sensor Type		CO ₂
Sensor Min Point 0V		0450
Sensor Max Ponit 10V		1850
Switch Input 1		Kitchen
Switch Input 2		Wet Room
Switch Input 3		SUMMERboost®
Live Switch 1 (LS1)		Kitchen
Live Switch 2 (LS2)		Wet Room


Timer Setback SPEED1

Configurable Items		Default
Days 1 to 5	On 1	00:00
	Off 1	06:00
	On 2	12:00
	Off 2	12:00
	On 3	23:00
	Off 3	00:00
Days 6 & 7	On 1	00:00
	Off 1	06:30
	On 2	12:00
	Off 2	12:00
	On 3	23:00
	Off 3	00:00

Timer Boost SPEED3

Configurable Items		Default
Days 1 to 5	On 1	07:00
	Off 1	08:00
	On 2	12:00
	Off 2	12:00
	On 3	18:00
	Off 3	09:00
Days 6 & 7	On 1	08:00
	Off 1	09:00
	On 2	12:00
	Off 2	12:00
	On 3	18:00
	Off 3	19:00

Notes

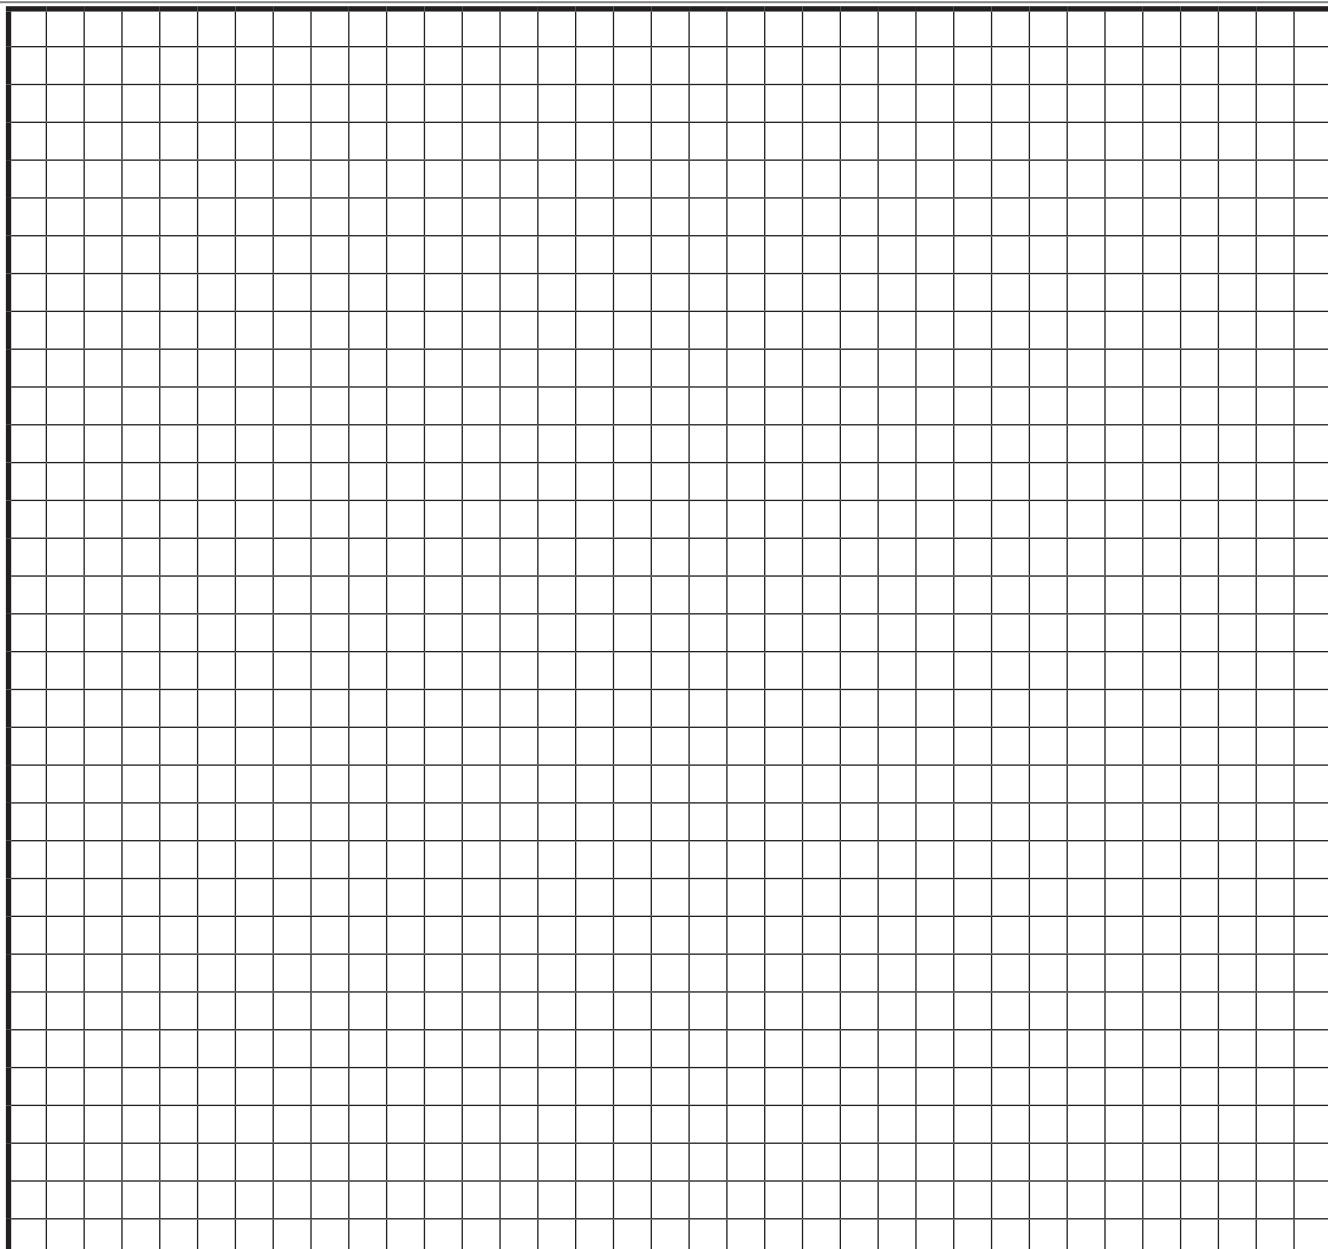A large 20x20 grid for notes.

Menu Maps Ventilation


SETUP1 1 of 2

Setup
Time

Setup
Day of week


Setup
Backlight

Setup
Boost Overrun
Timer

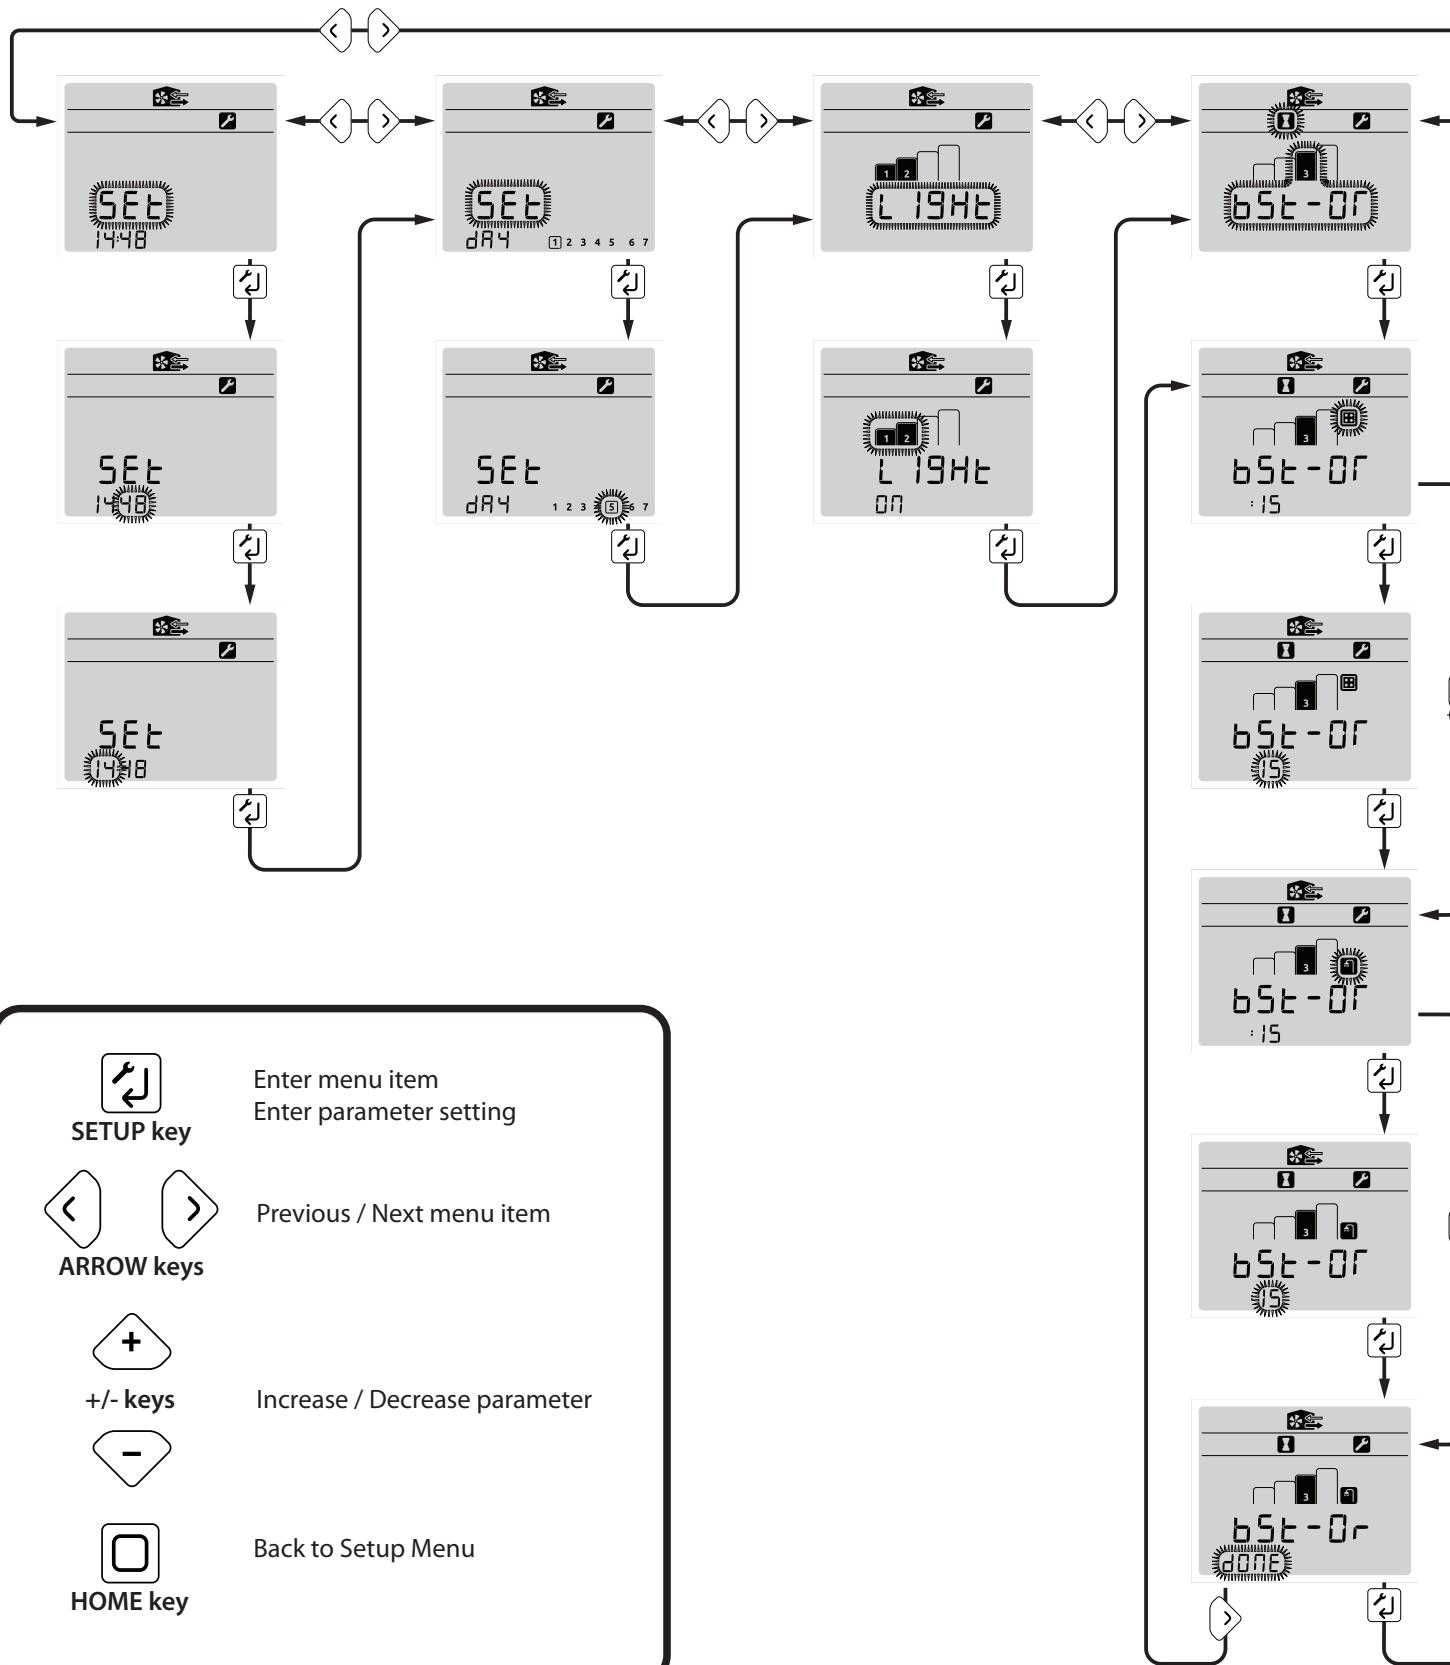


Setup
Boost Delay
Timer

Boost Inhibit
On/Off

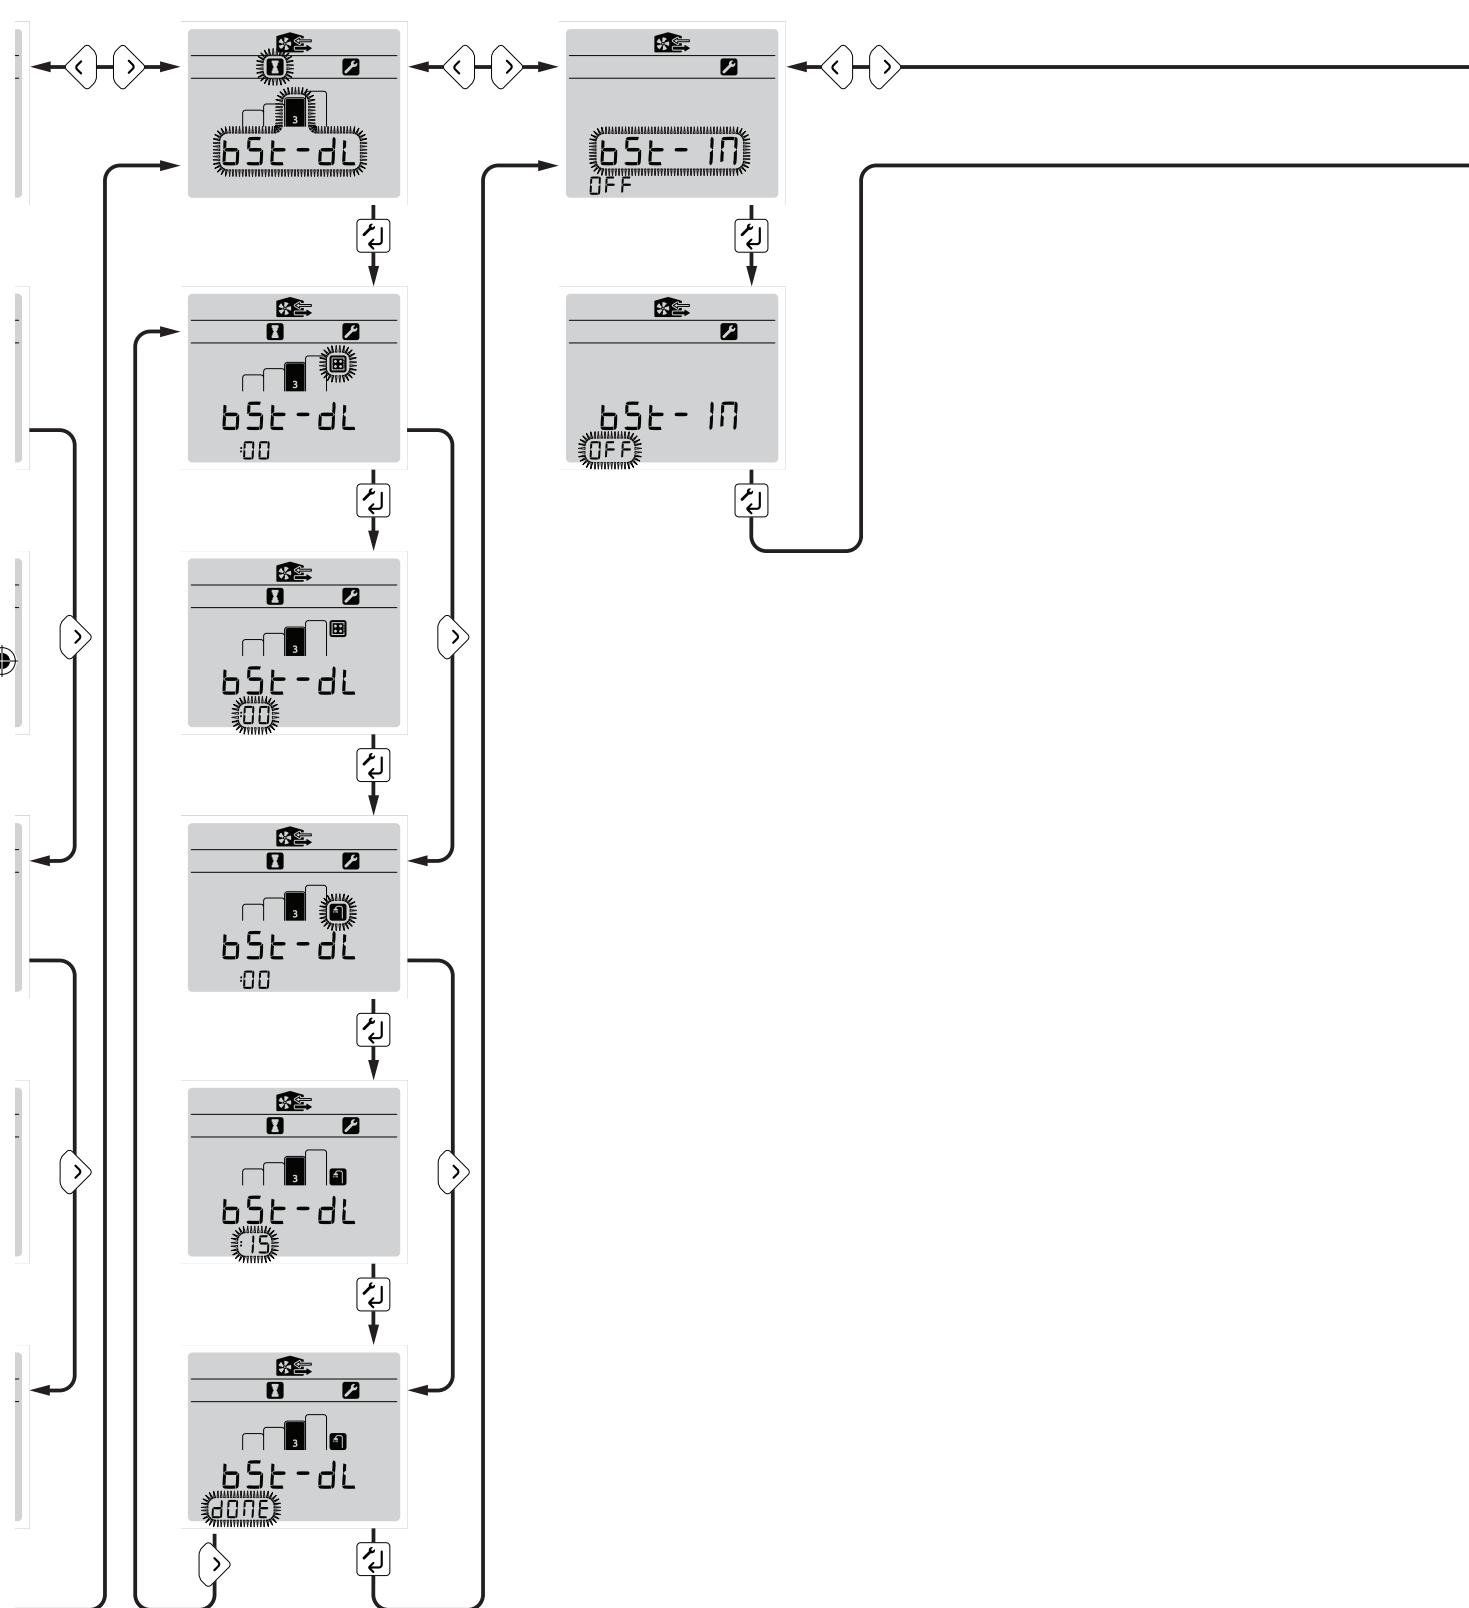

SETUP1 2 of 2

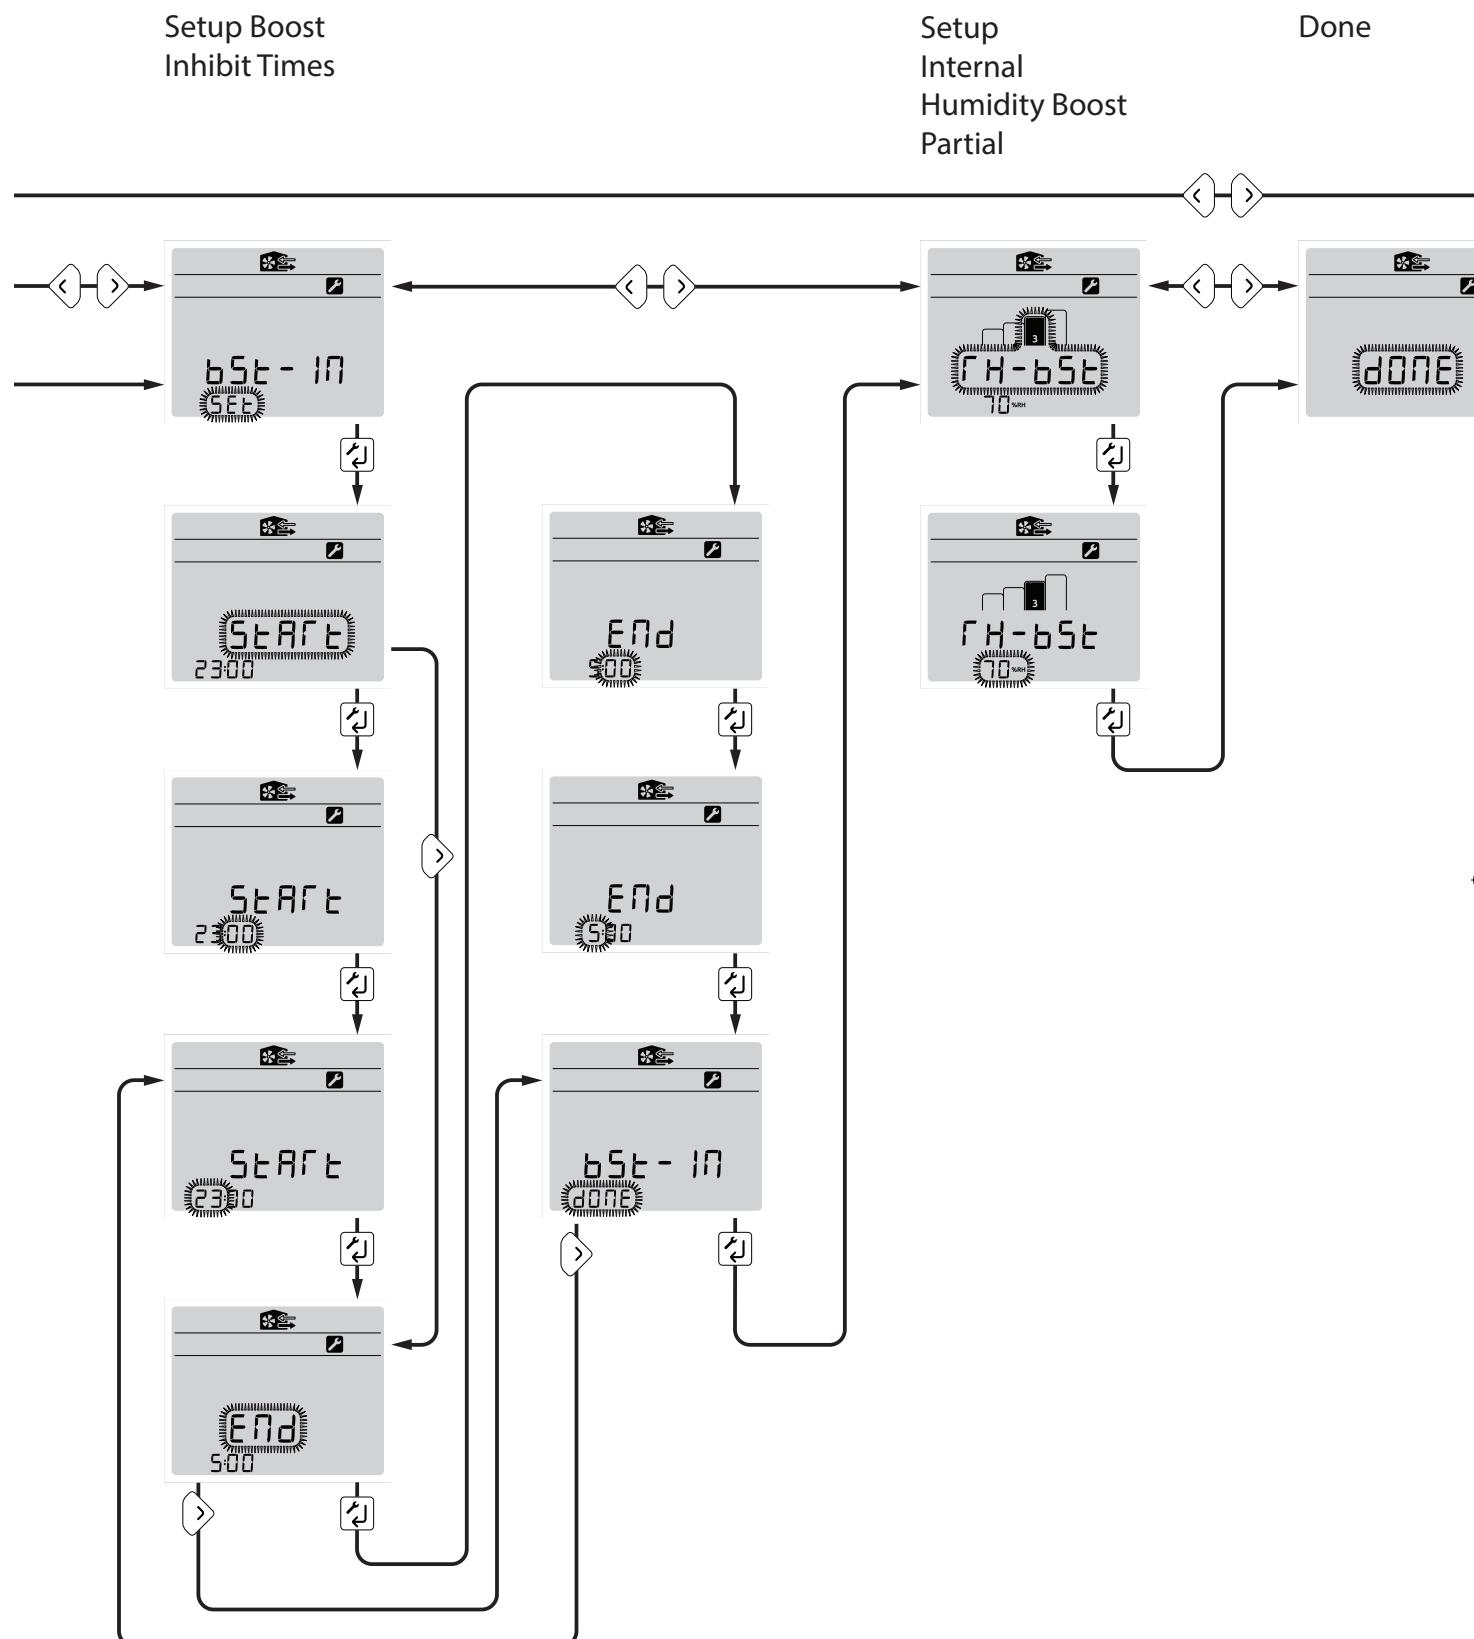



SETUP key

Enter menu item
Enter parameter setting



ARROW keys

Previous / Next menu item



+/‐ keys

Increase / Decrease parameter



HOME key

Back to Setup Menu


SETUP2 1 of 4

Run Timer

Filter Change
Reset

Setup
Filter Change
Interval


Setup
Boost Overrun
Timer

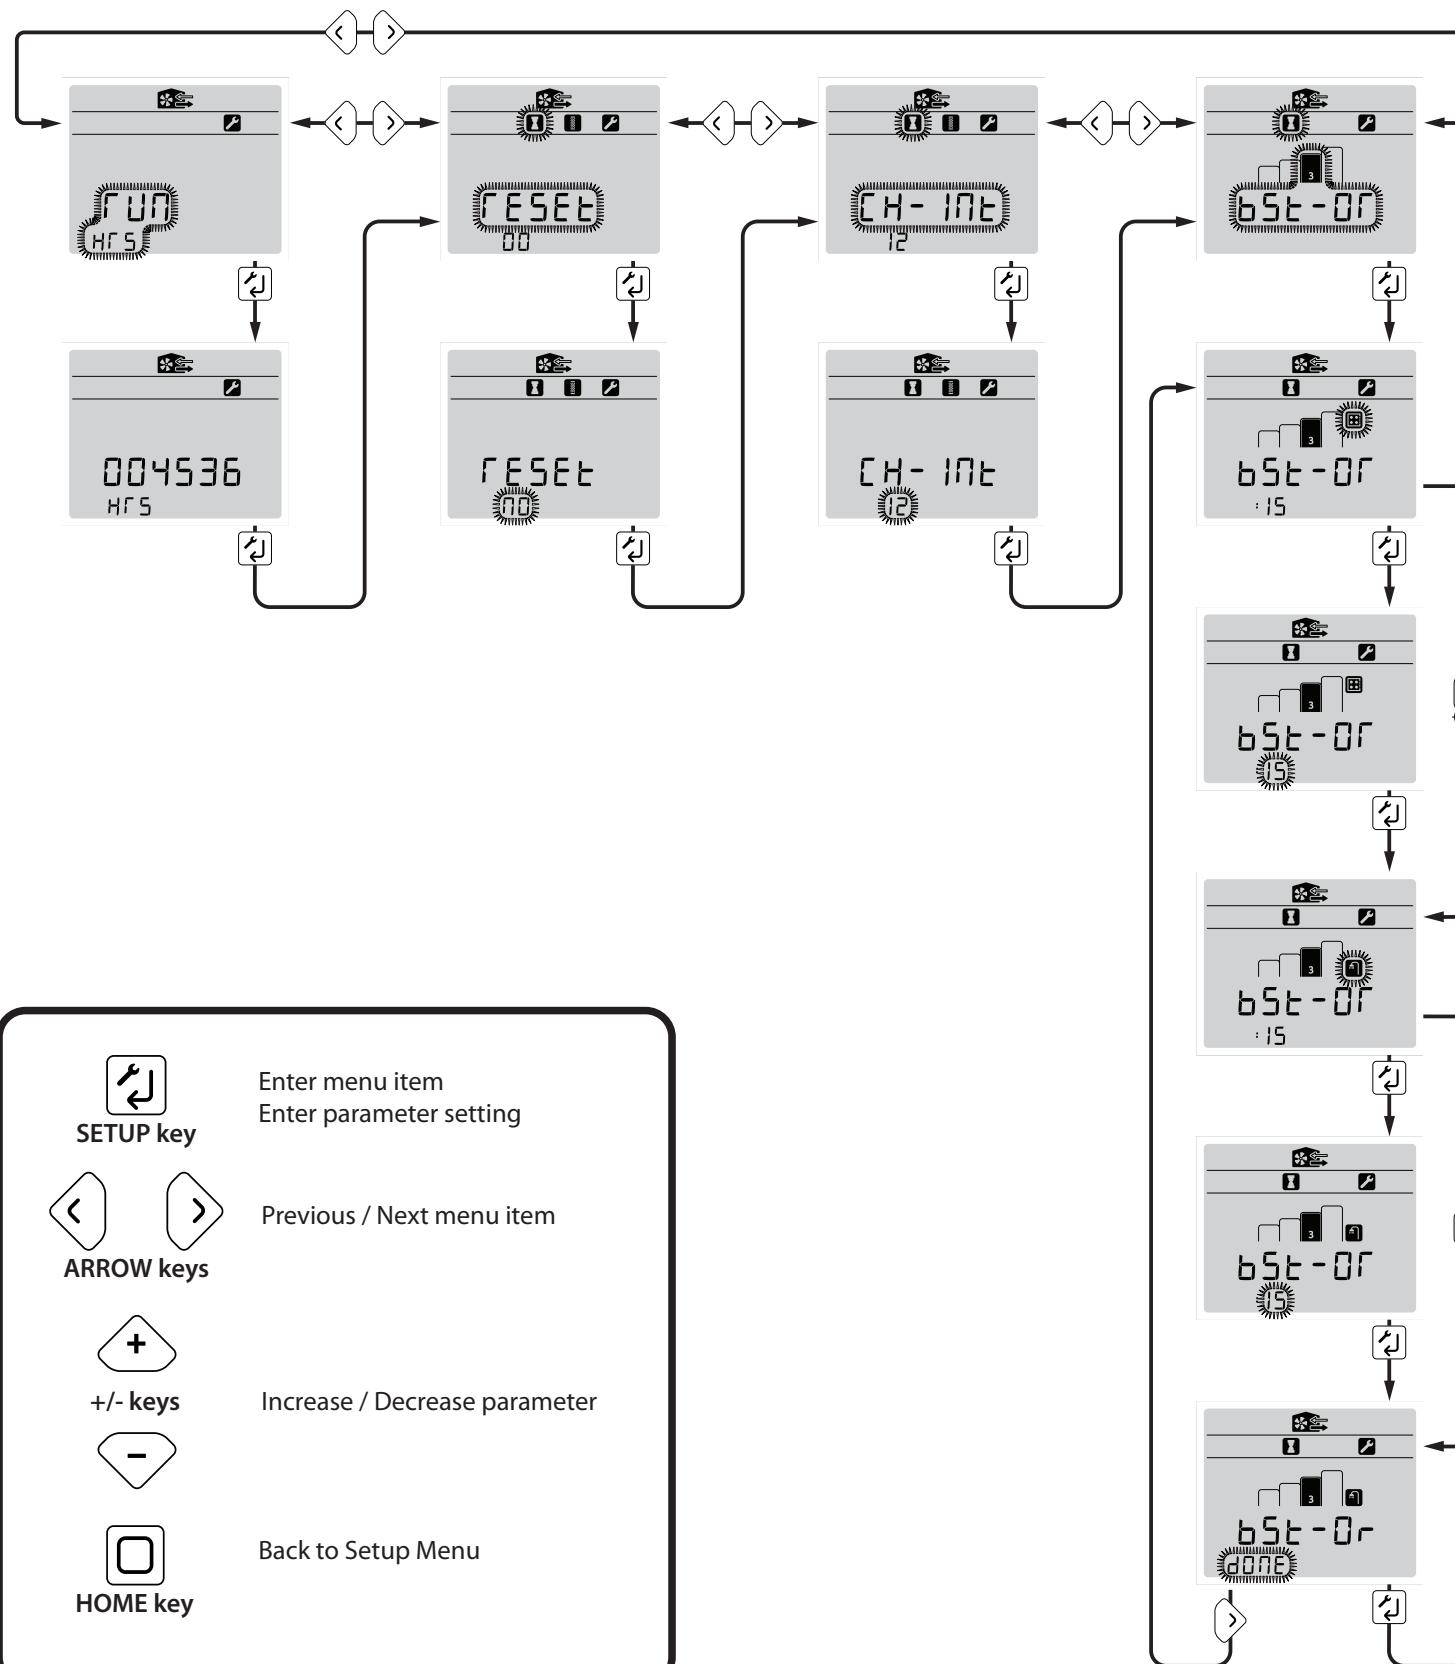


Setup
Boost Delay
Timer

Setup
Speed 4
SUMMERBoost®

Boost
Alert On/Off

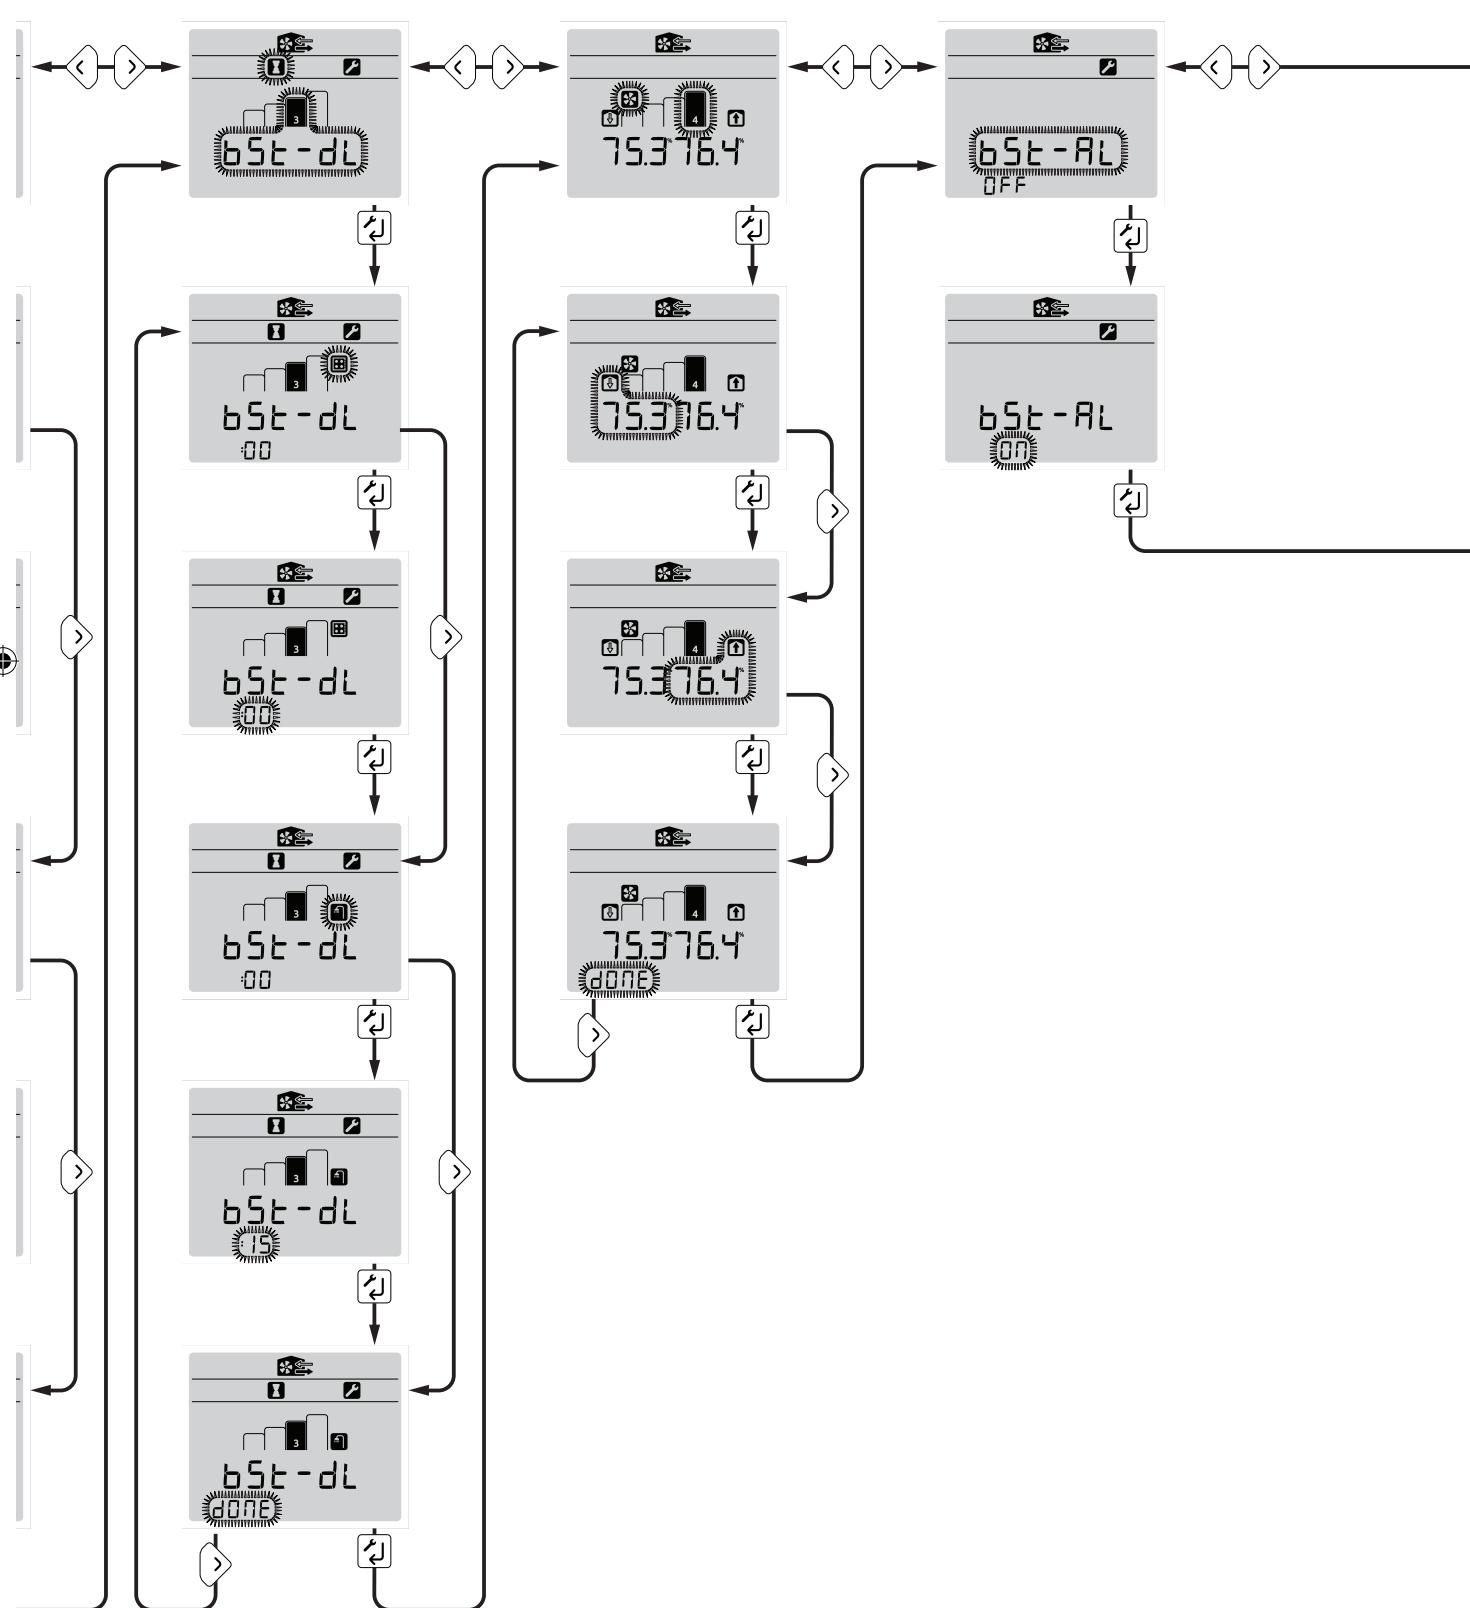


SETUP2 2 of 4

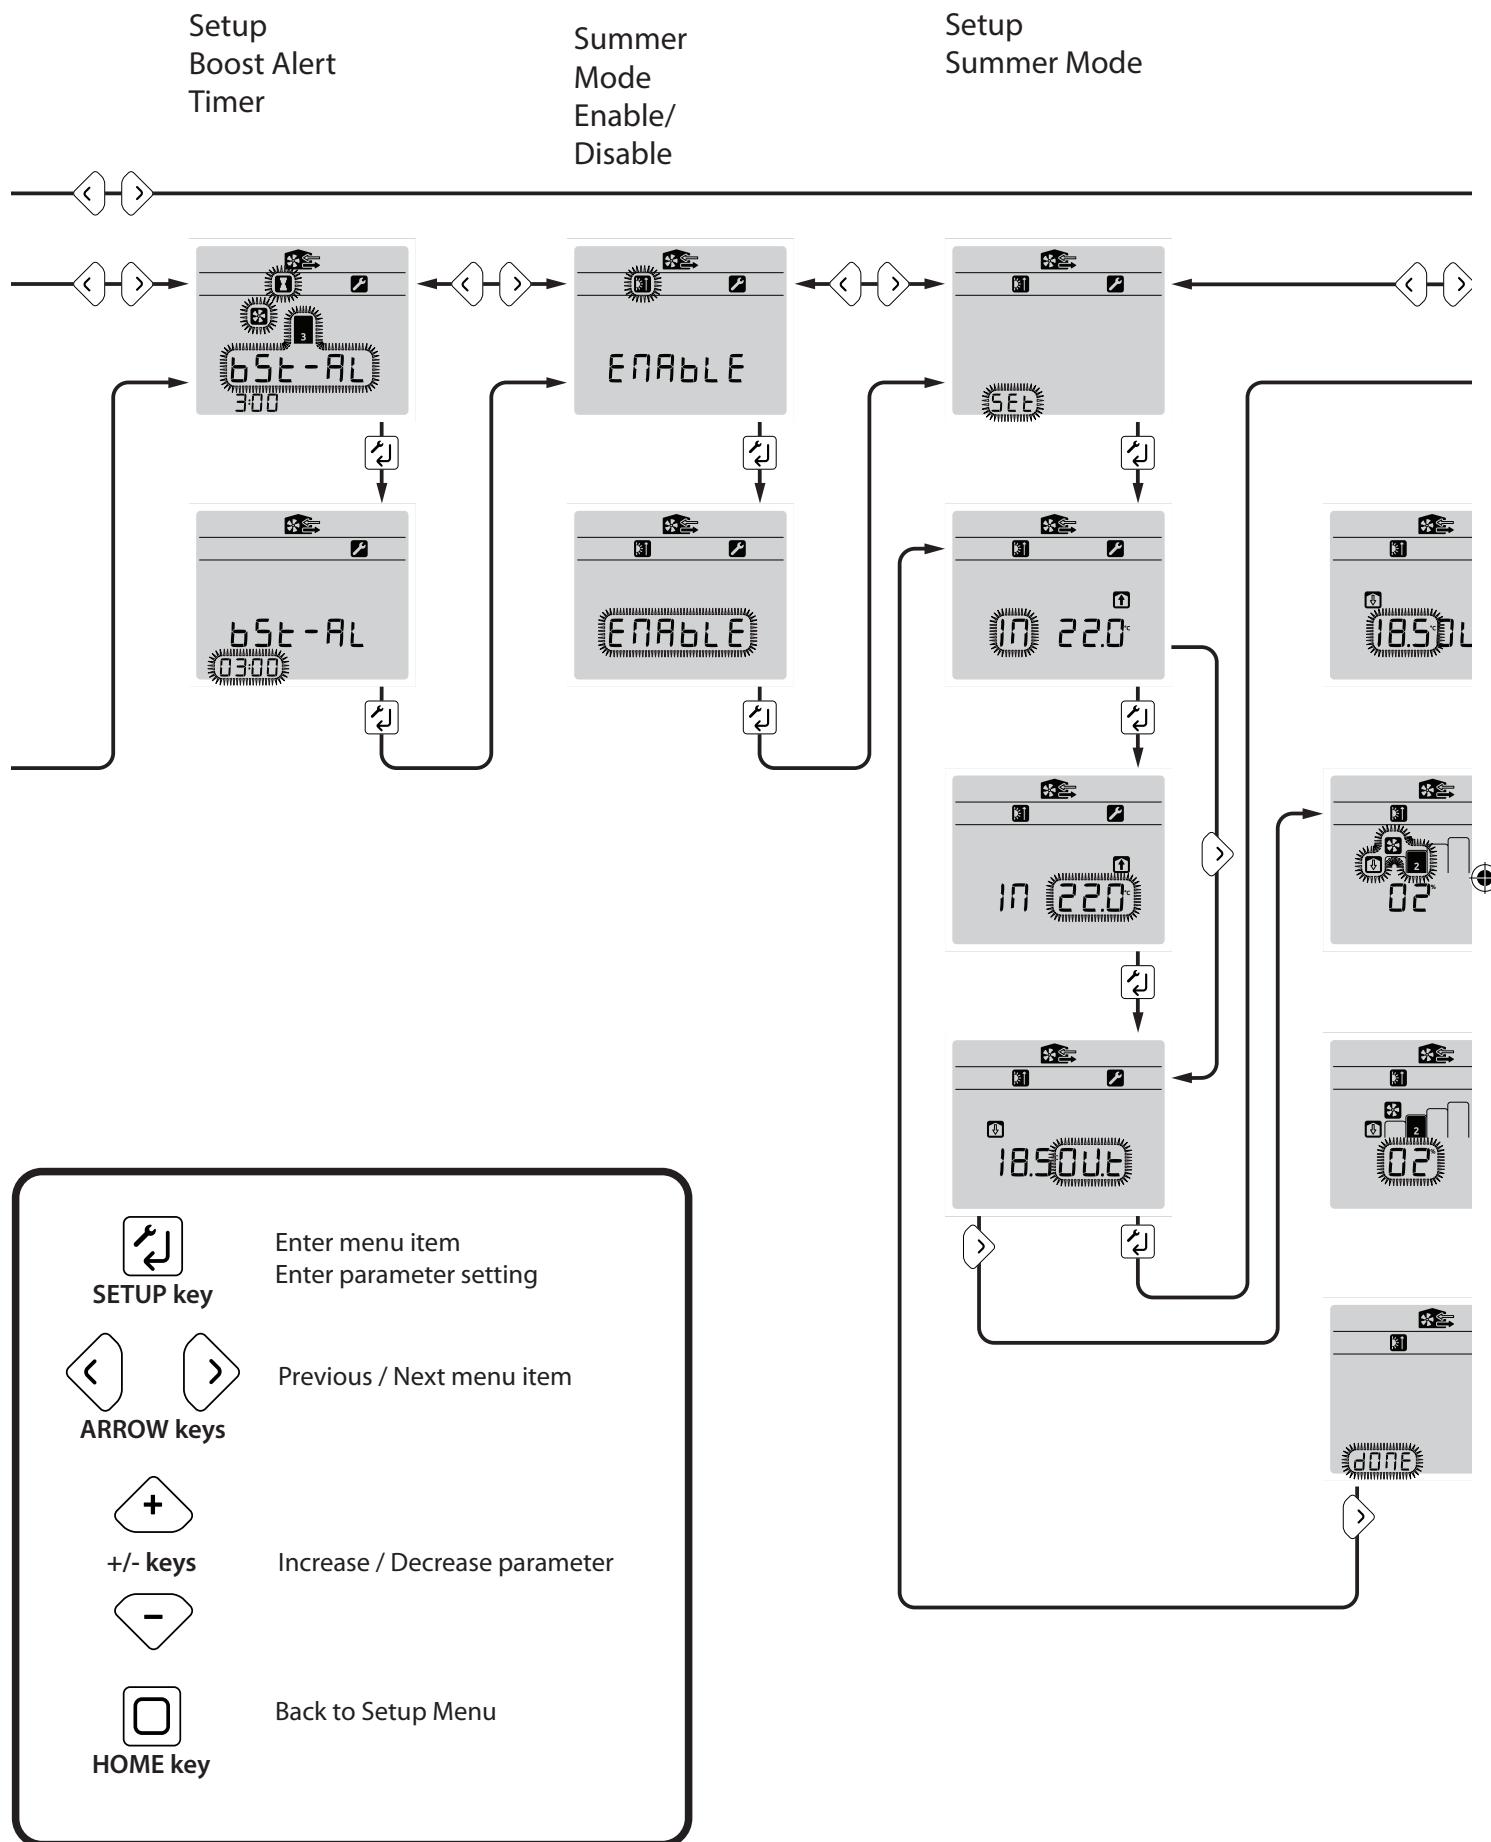


Summer By-Pass Enable/Disable

Setup Summer By-Pass

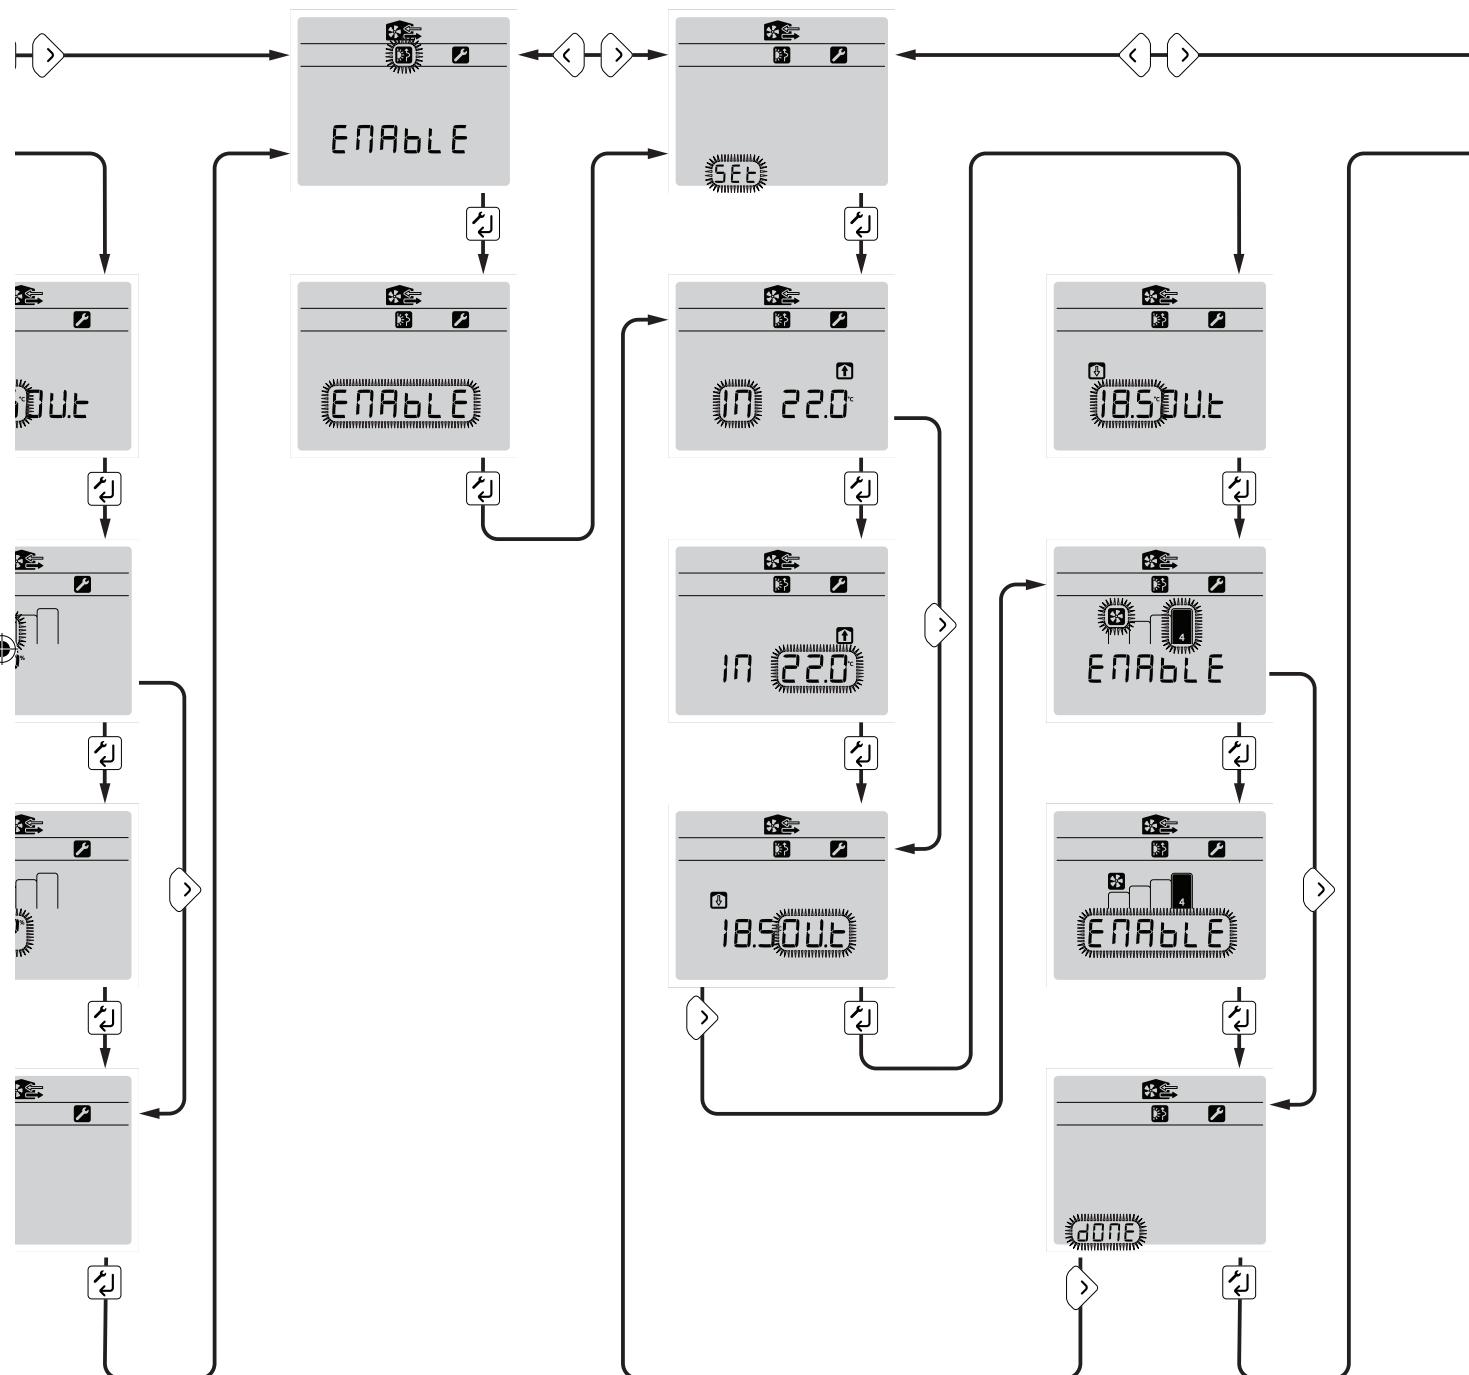


SETUP2 3 of 4

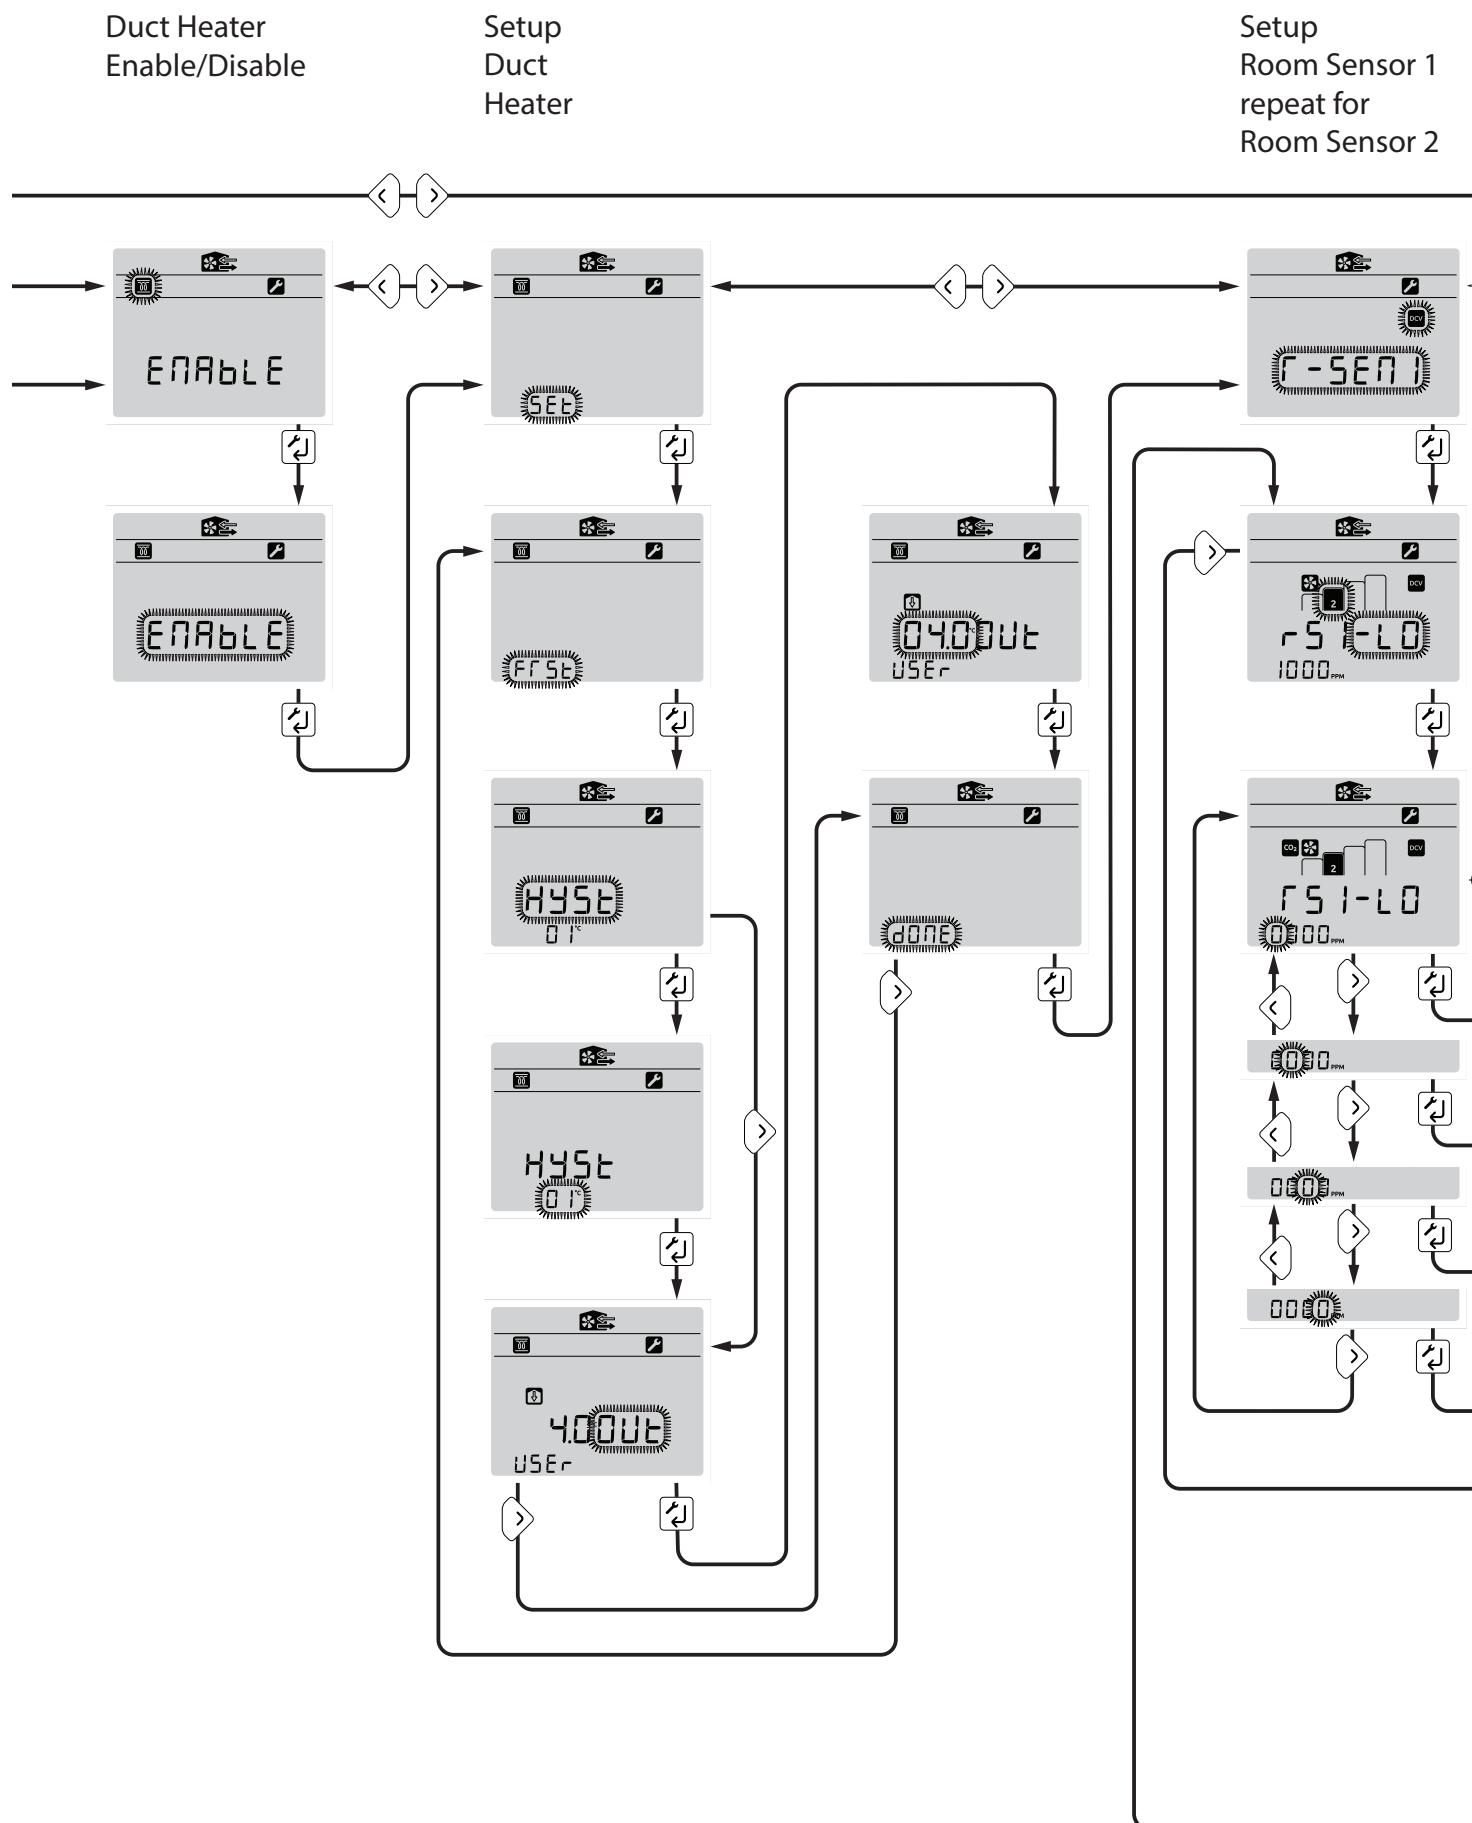


NOTE:
Room Sensor settings are
only available in this menu
when enabled in SETUP3.

Internal
Humidity Boost
On/Off

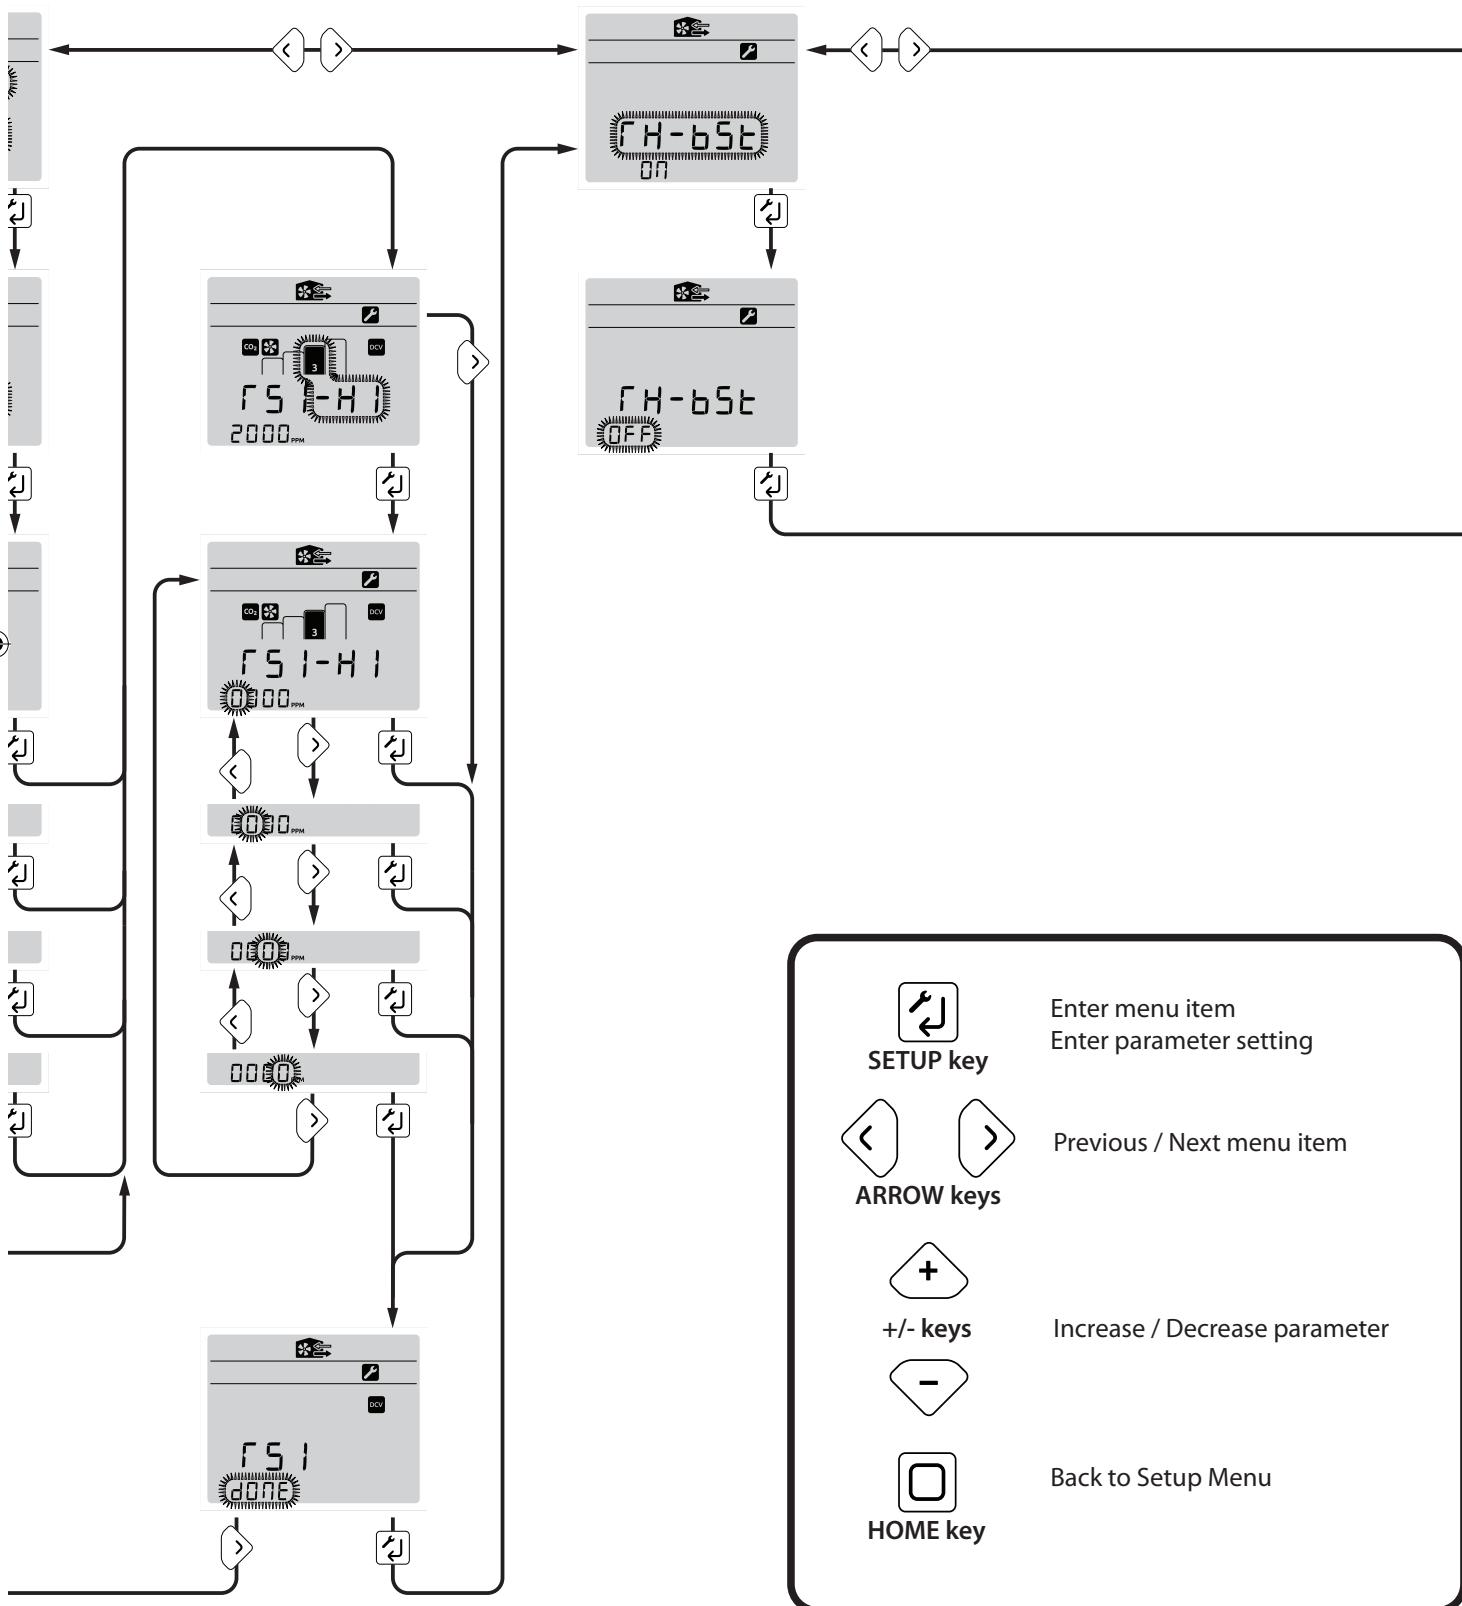

SETUP2 4 of 4

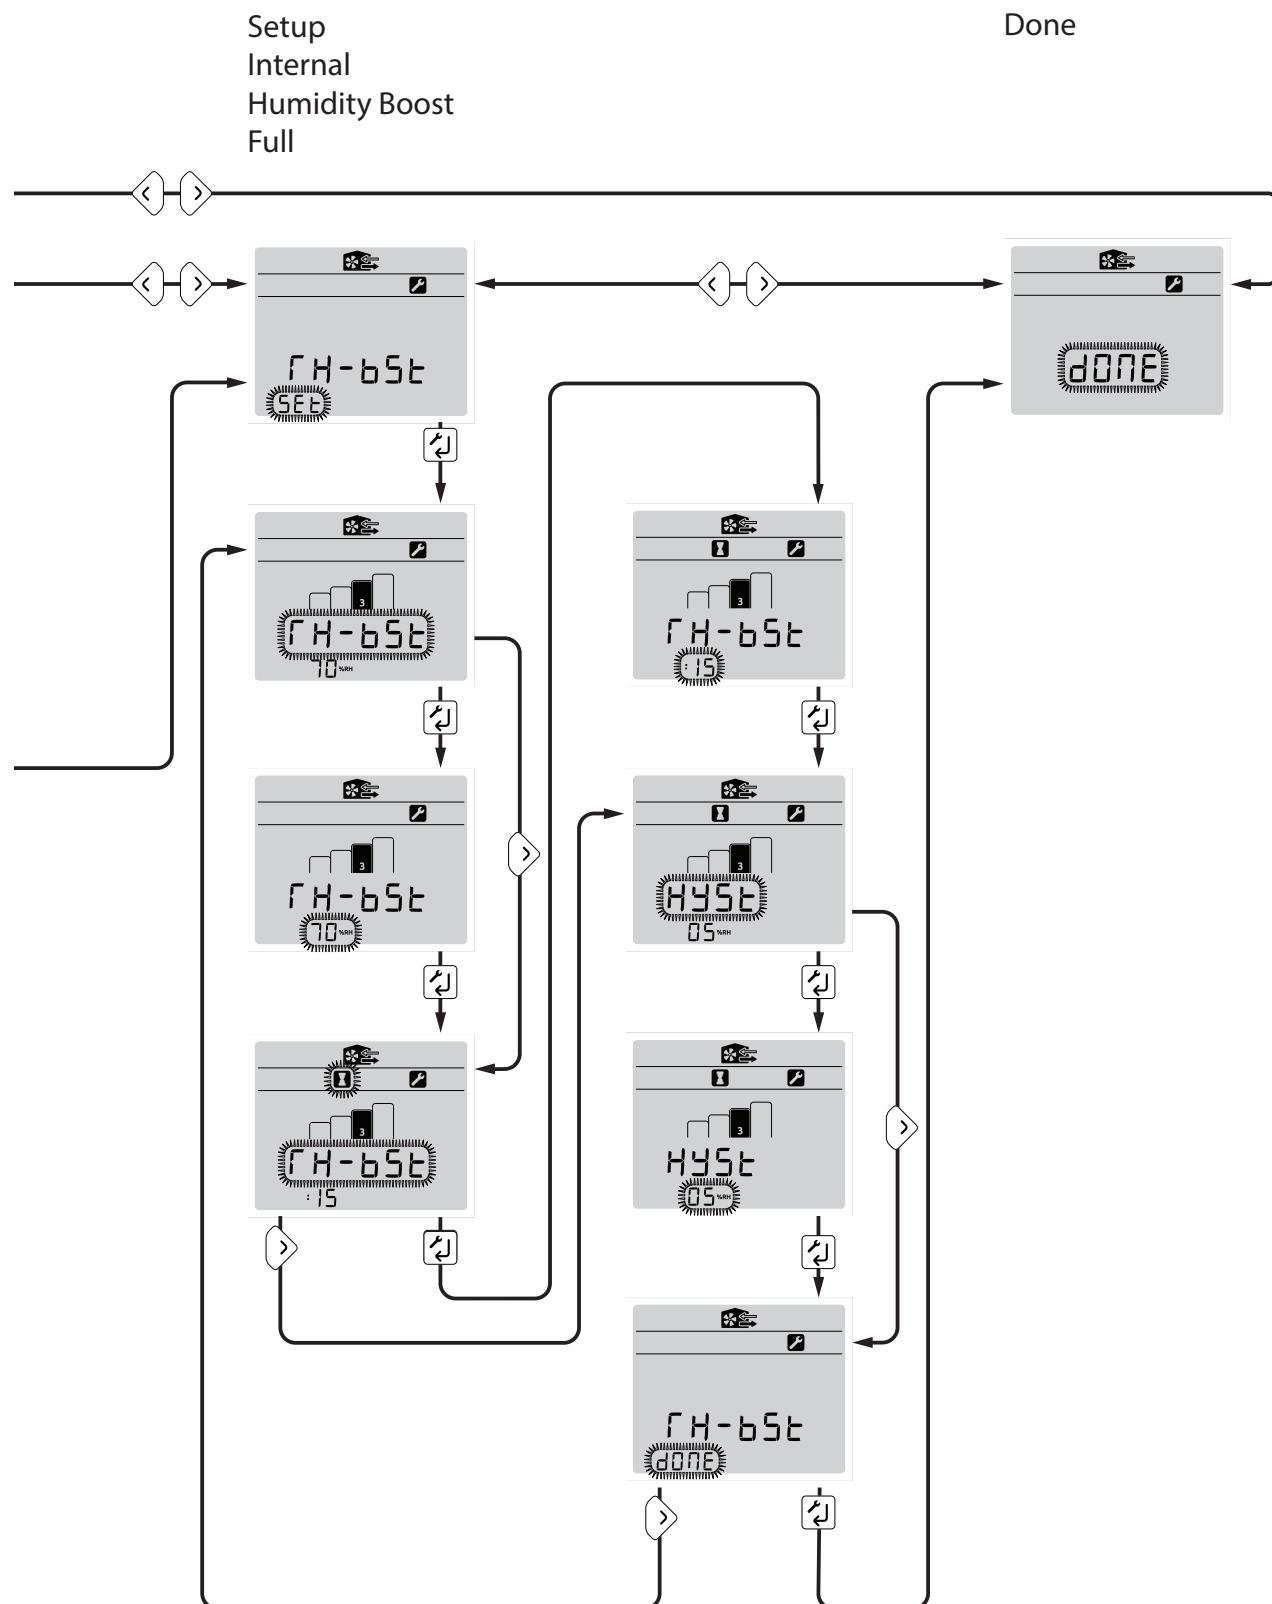



SETUP key

Enter menu item
Enter parameter setting



ARROW keys

Previous / Next menu item



+/‐ keys

Increase / Decrease parameter



HOME key

Back to Setup Menu


SETUP3 1 of 2

Passcode

Setup Continuous
SPEED2

Setup Boost
SPEED3

Setup Setback
SPEED1

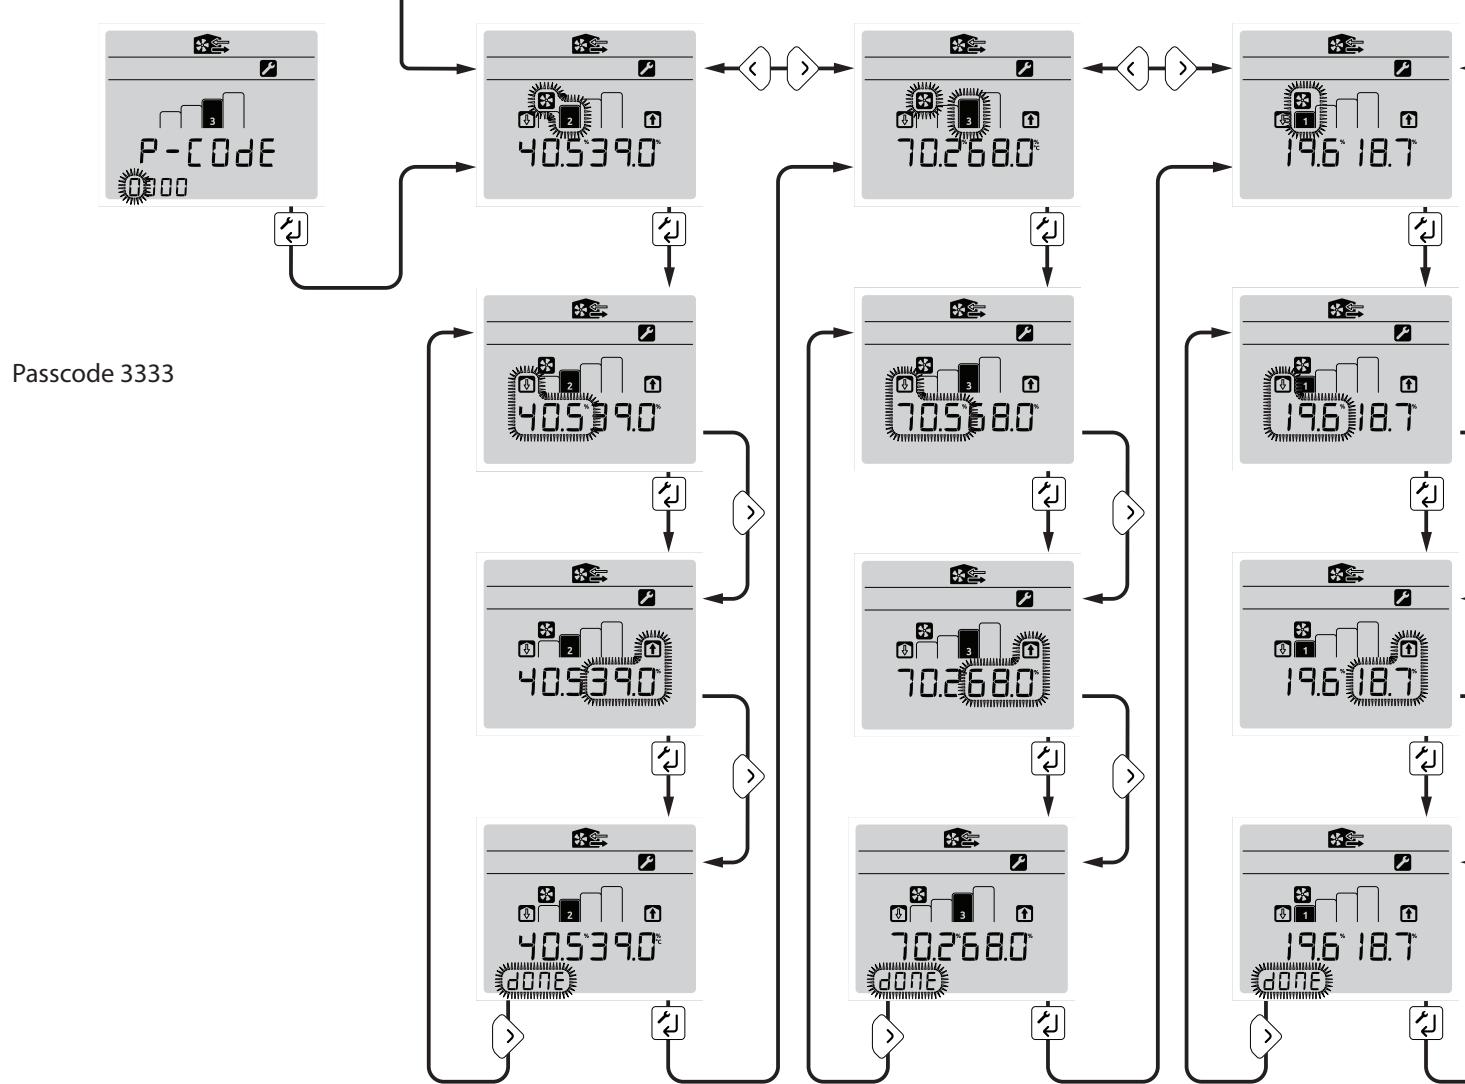

SETUP key

Enter menu item
Enter parameter setting



+/- keys

Increase / Decrease parameter



Previous / Next menu item




HOME key

Back to Setup Menu


Setup
Boost Overrun
Timer

Setup
Boost Delay
Timer

Setup
SUMMERBoost®
SPEED4

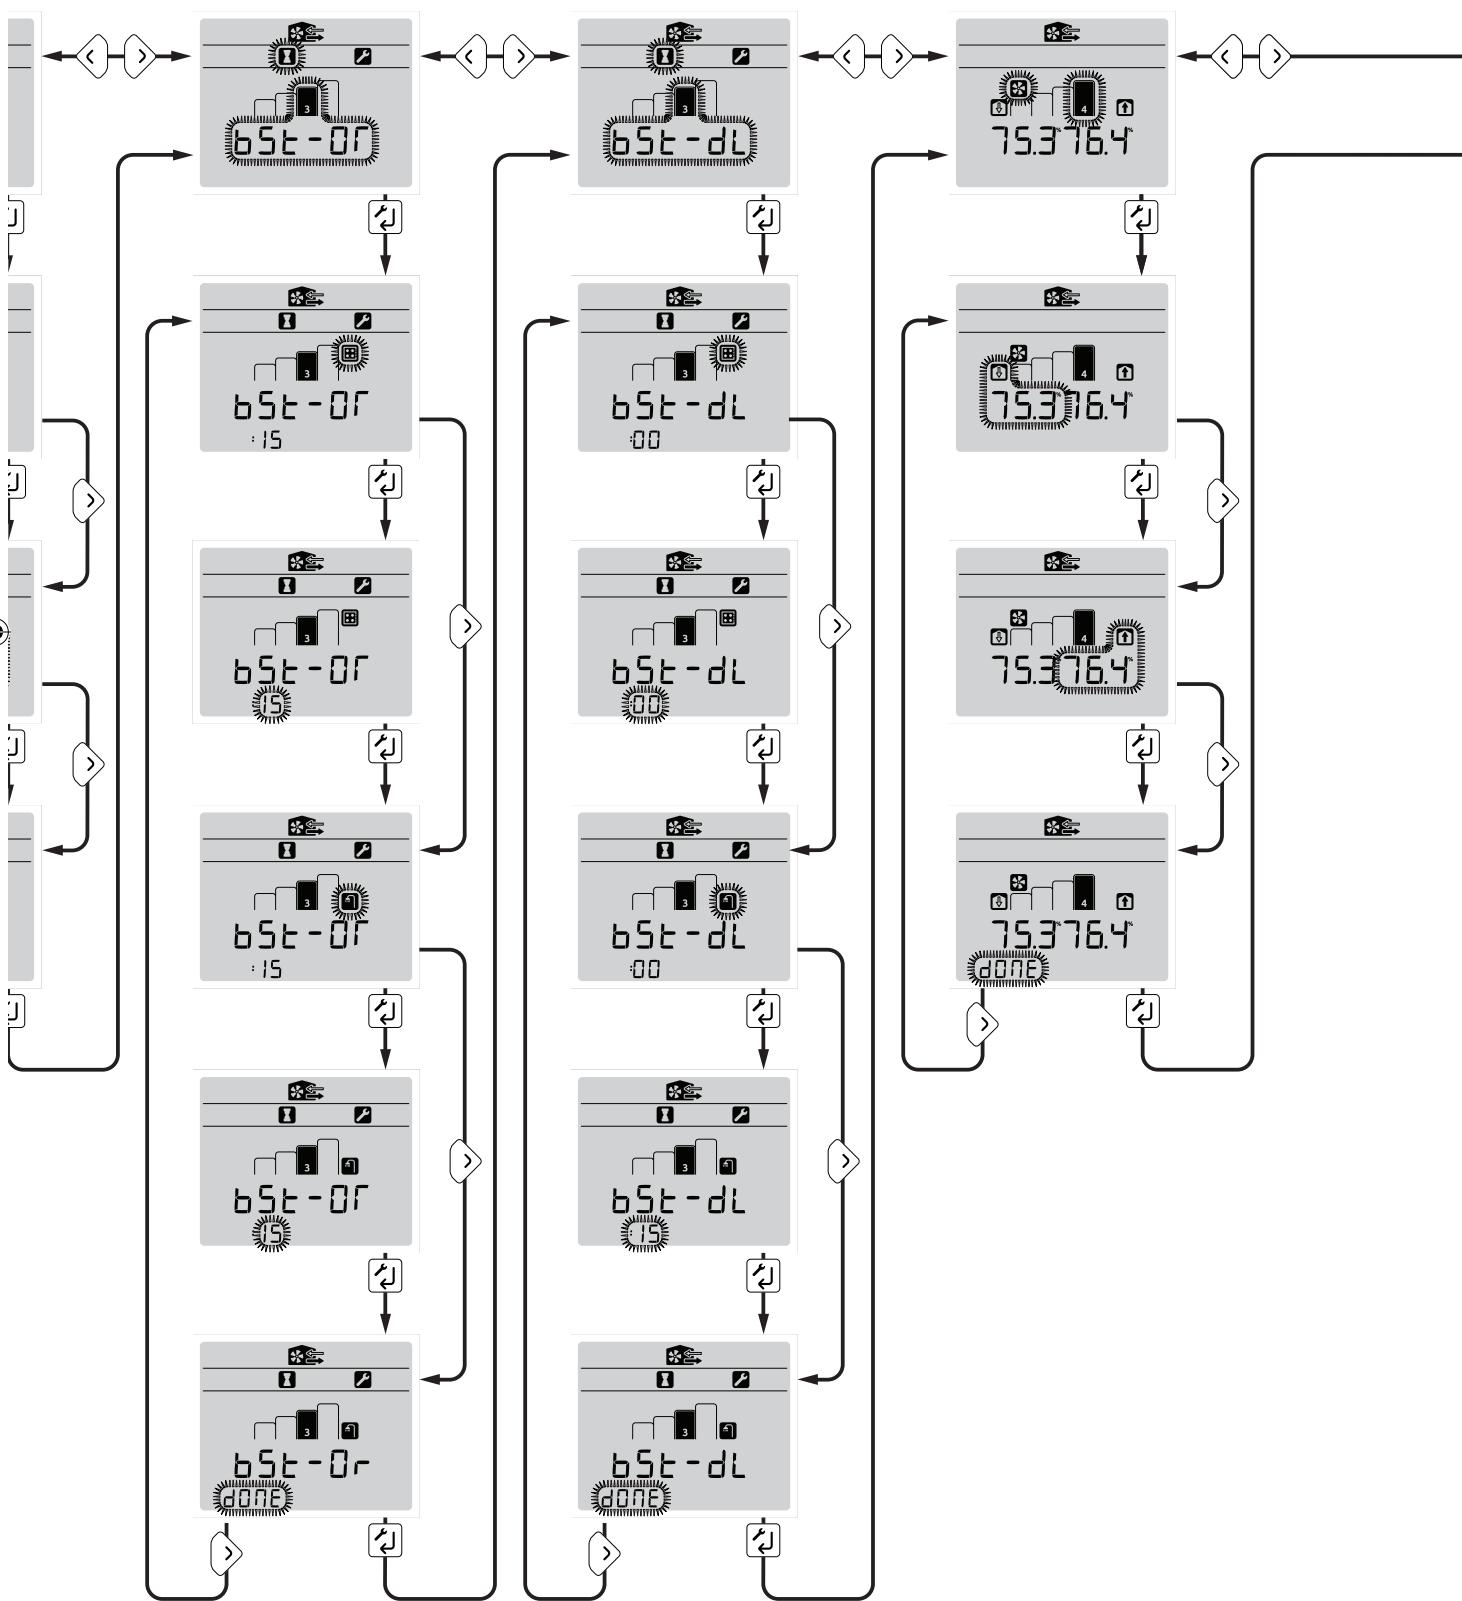



SETUP3 2 of 2

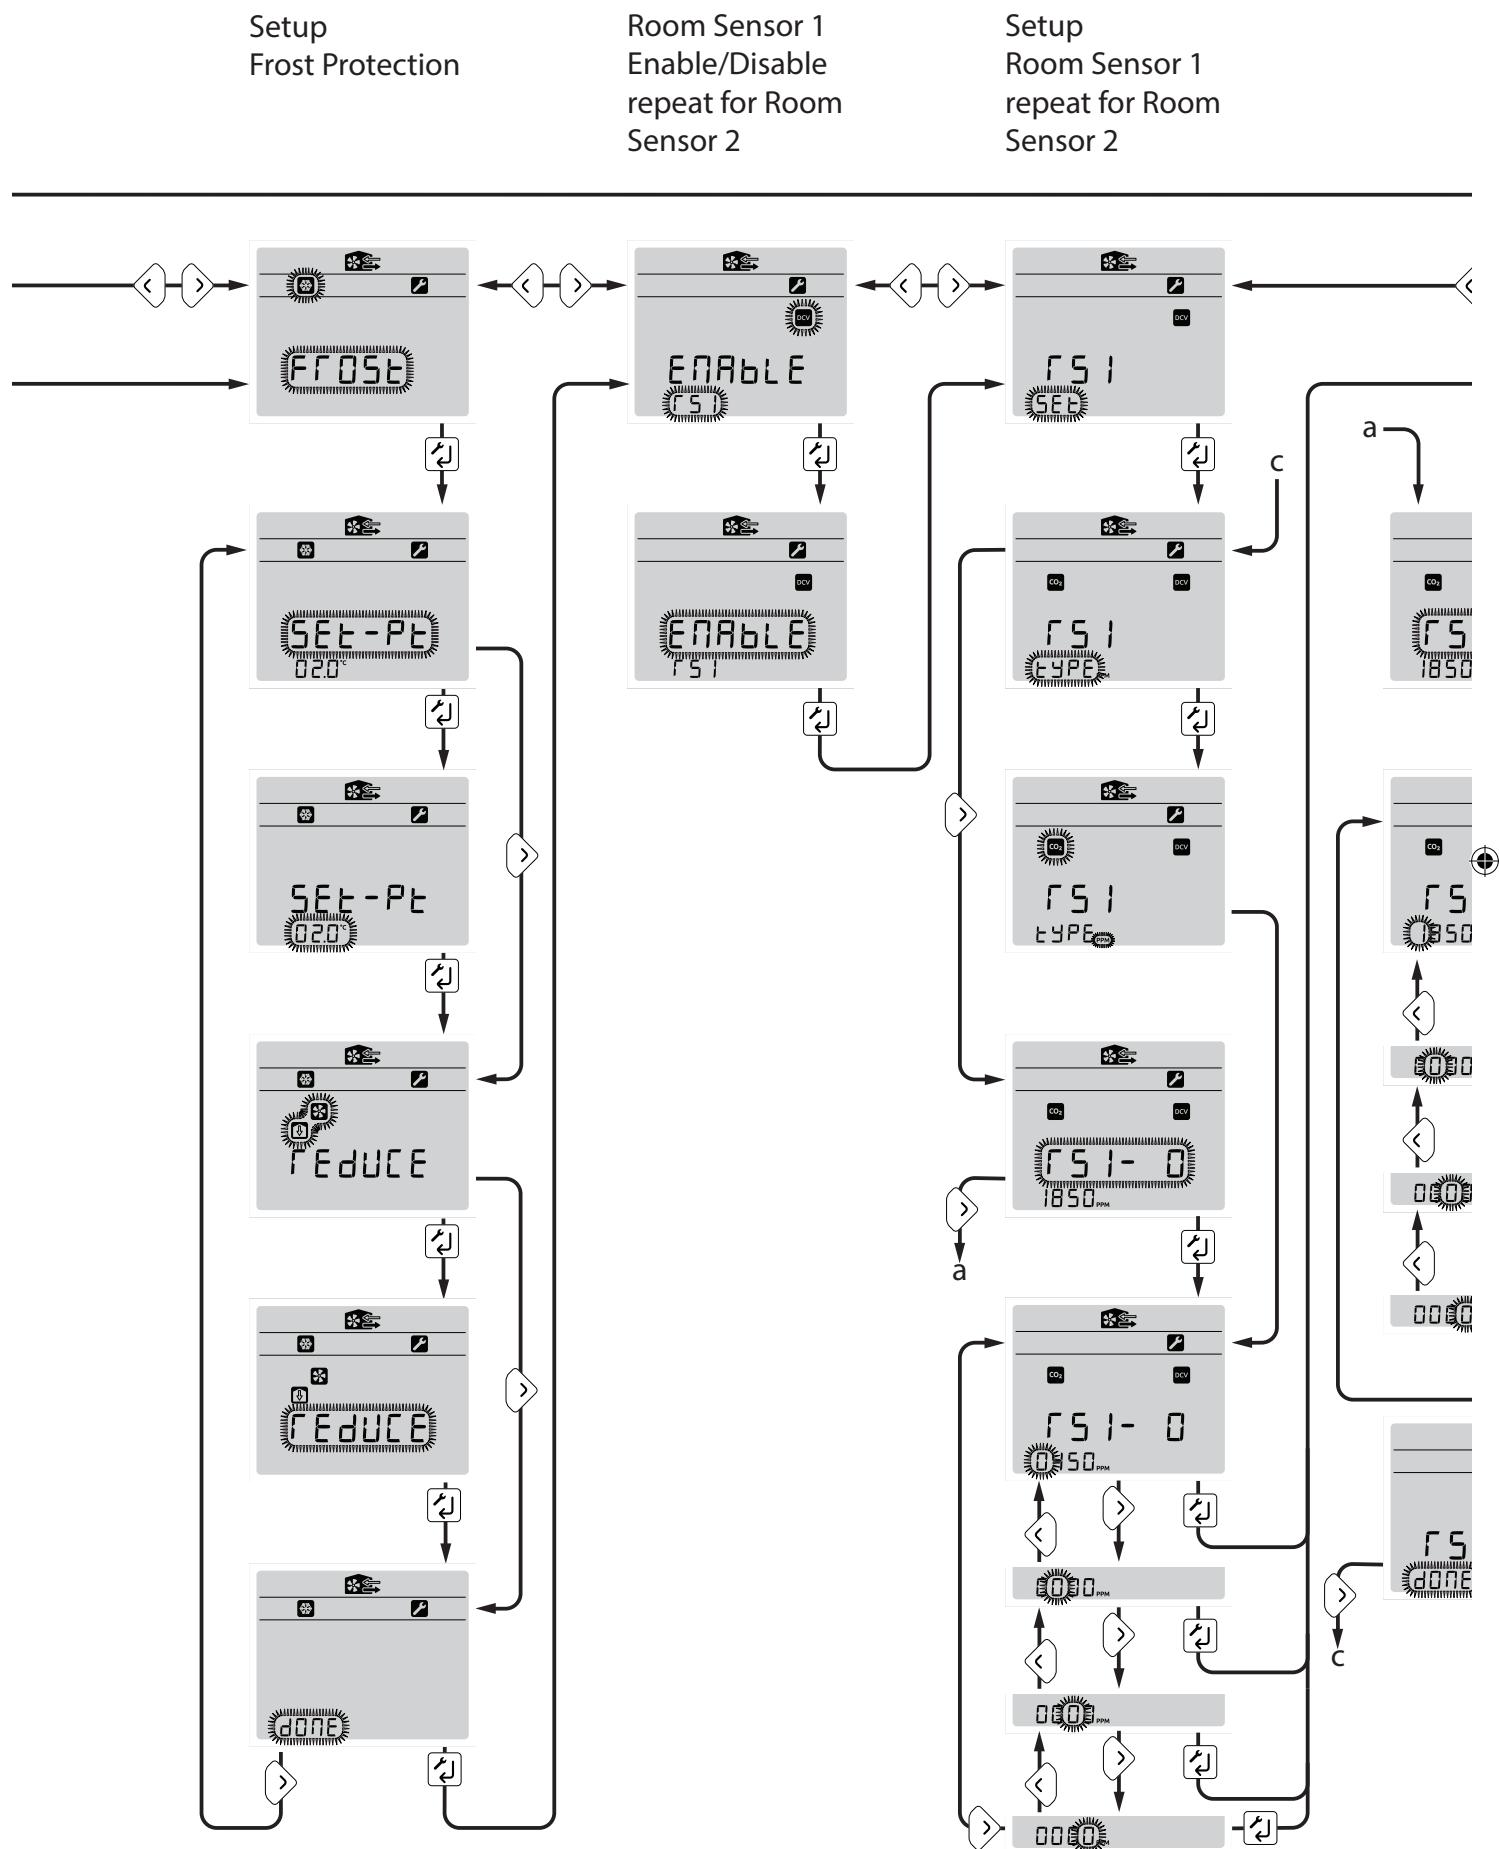

Setup
Switch Input 1
repeat for
Switch Input 2 & 3

Setup
Live Switch 1
repeat for
Live Switch 2

Done

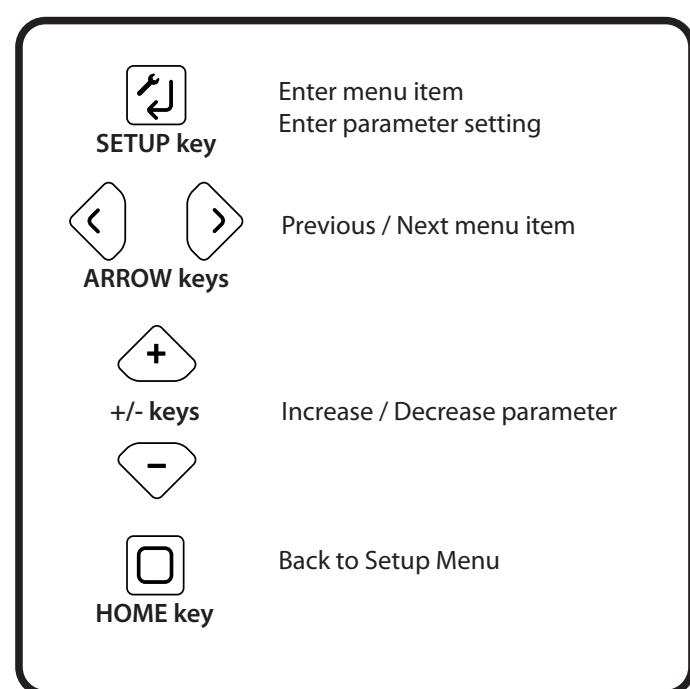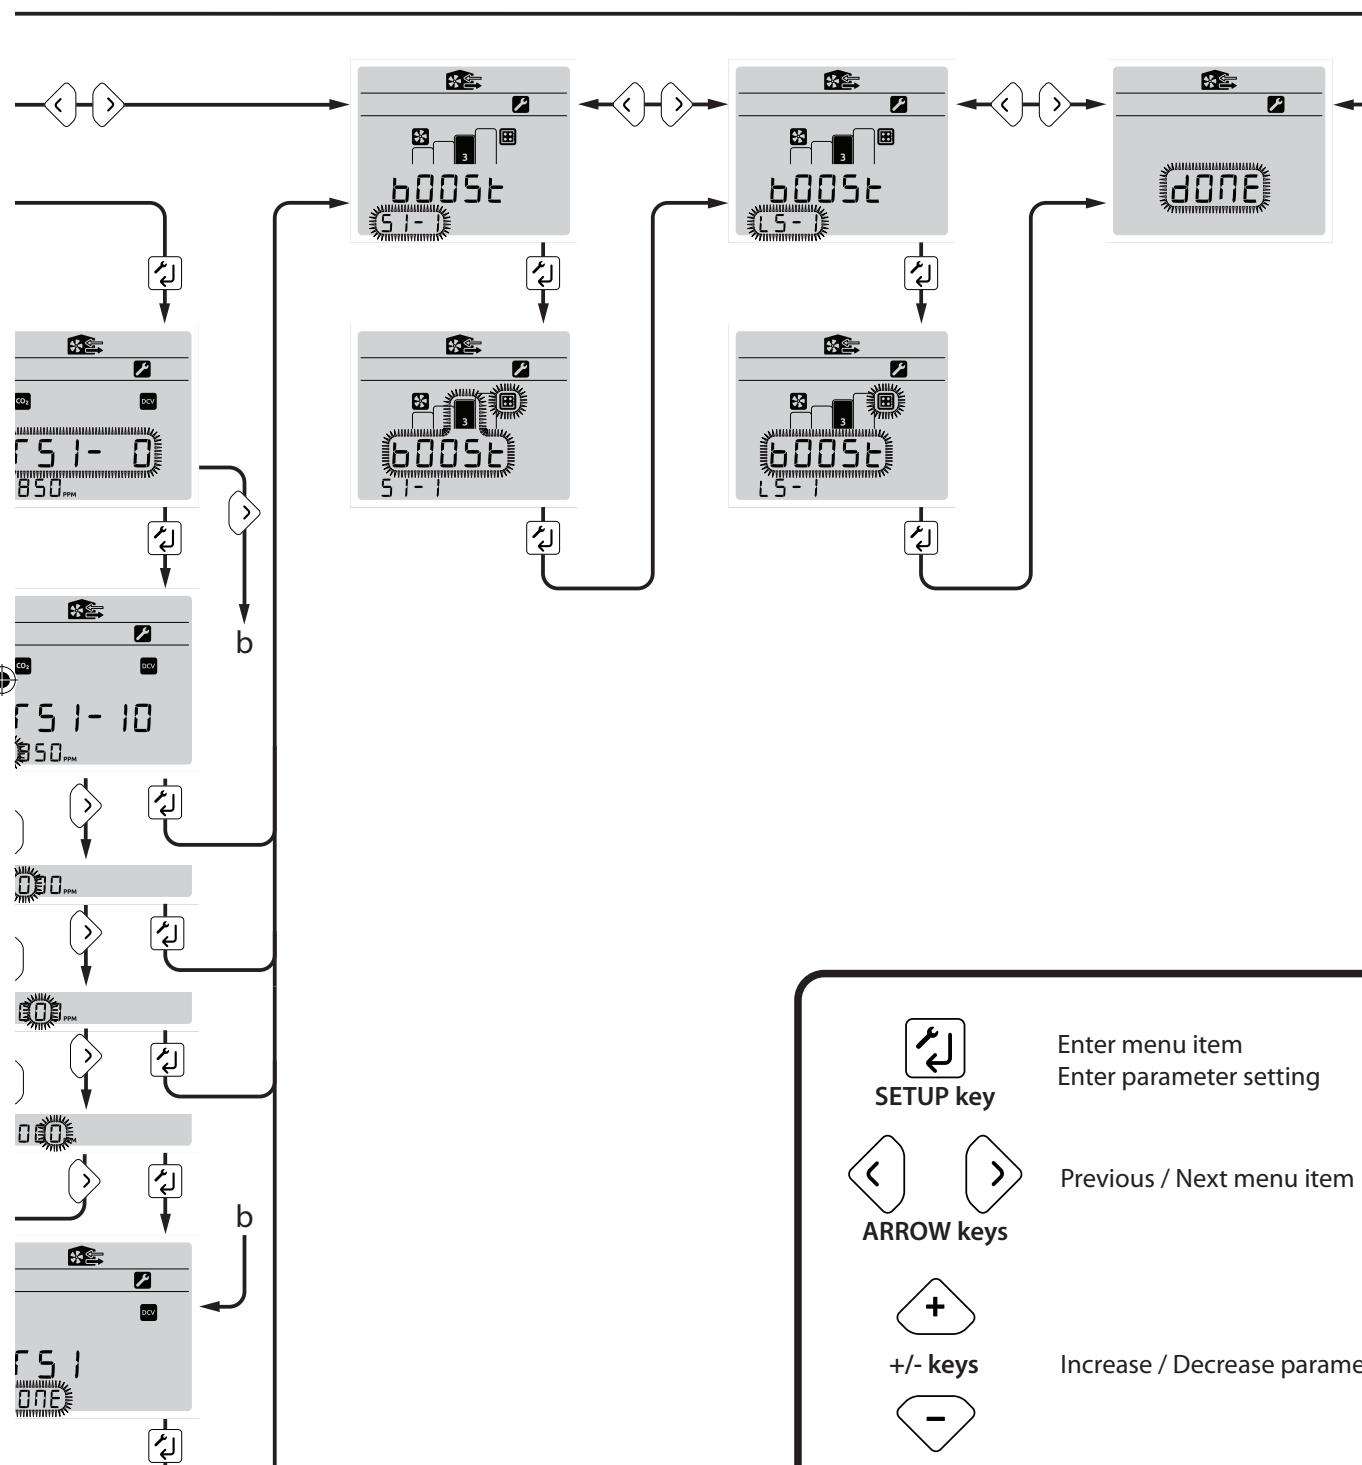


RESET4 1 of 1

Passcode

Reset

Returned to
SETUP1

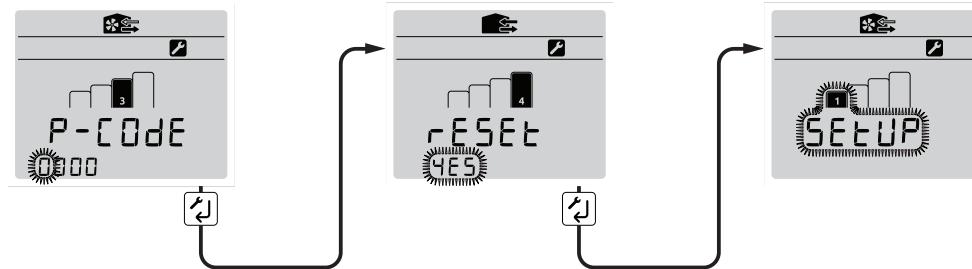

Passcode 6840

Selecting Yes returns ALL configurable
values, except commissioned fan speeds
to the default values and returns to
SETUP1 menu.

The aurastat® VT is maintenance free.

Cleaning Exterior

For best results use a clean damp cloth. Do not use abrasive cleaners, solvents or any other fluids.

Error Codes

Find below the error codes that the aurastat may display.

- 6 RS485 Timeout
- 7 RS485 Invalid response
- 8 RS485 Invalid address
- 9 RS485 Invalid data
- 10 RS485 Invalid operation
- 11 RS485 Not ready
- 12 RS485 Error response

RS485 is the standard communication protocol that is used between the aurastat and the HRV unit. The above 7 error codes indicate a comms error between the aurastat and the HRV unit, check the wiring and connections.

- 13 Thermistor 1 error Problem with thermistor in Extract from dwelling airstream.
- 14 Thermistor 2 error Problem with thermistor in To Atmosphere airstream.
- 15 Thermistor 3 error Problem with thermistor in From Atmosphere airstream.
- 17 Fan1 error The software has not received a signal from the Supply to Dwelling fan.
- 18 Fan2 error The software has not received a signal from the Extract from Dwelling fan.

In the event of any queries please contact the system installer.


Menu Map Timers

Timer Setback SPEED1 & Boost SPEED2 Setup 1 of 1


Setup
Time

Setup
Day of week

Setup
Timers ON/OFF
periods

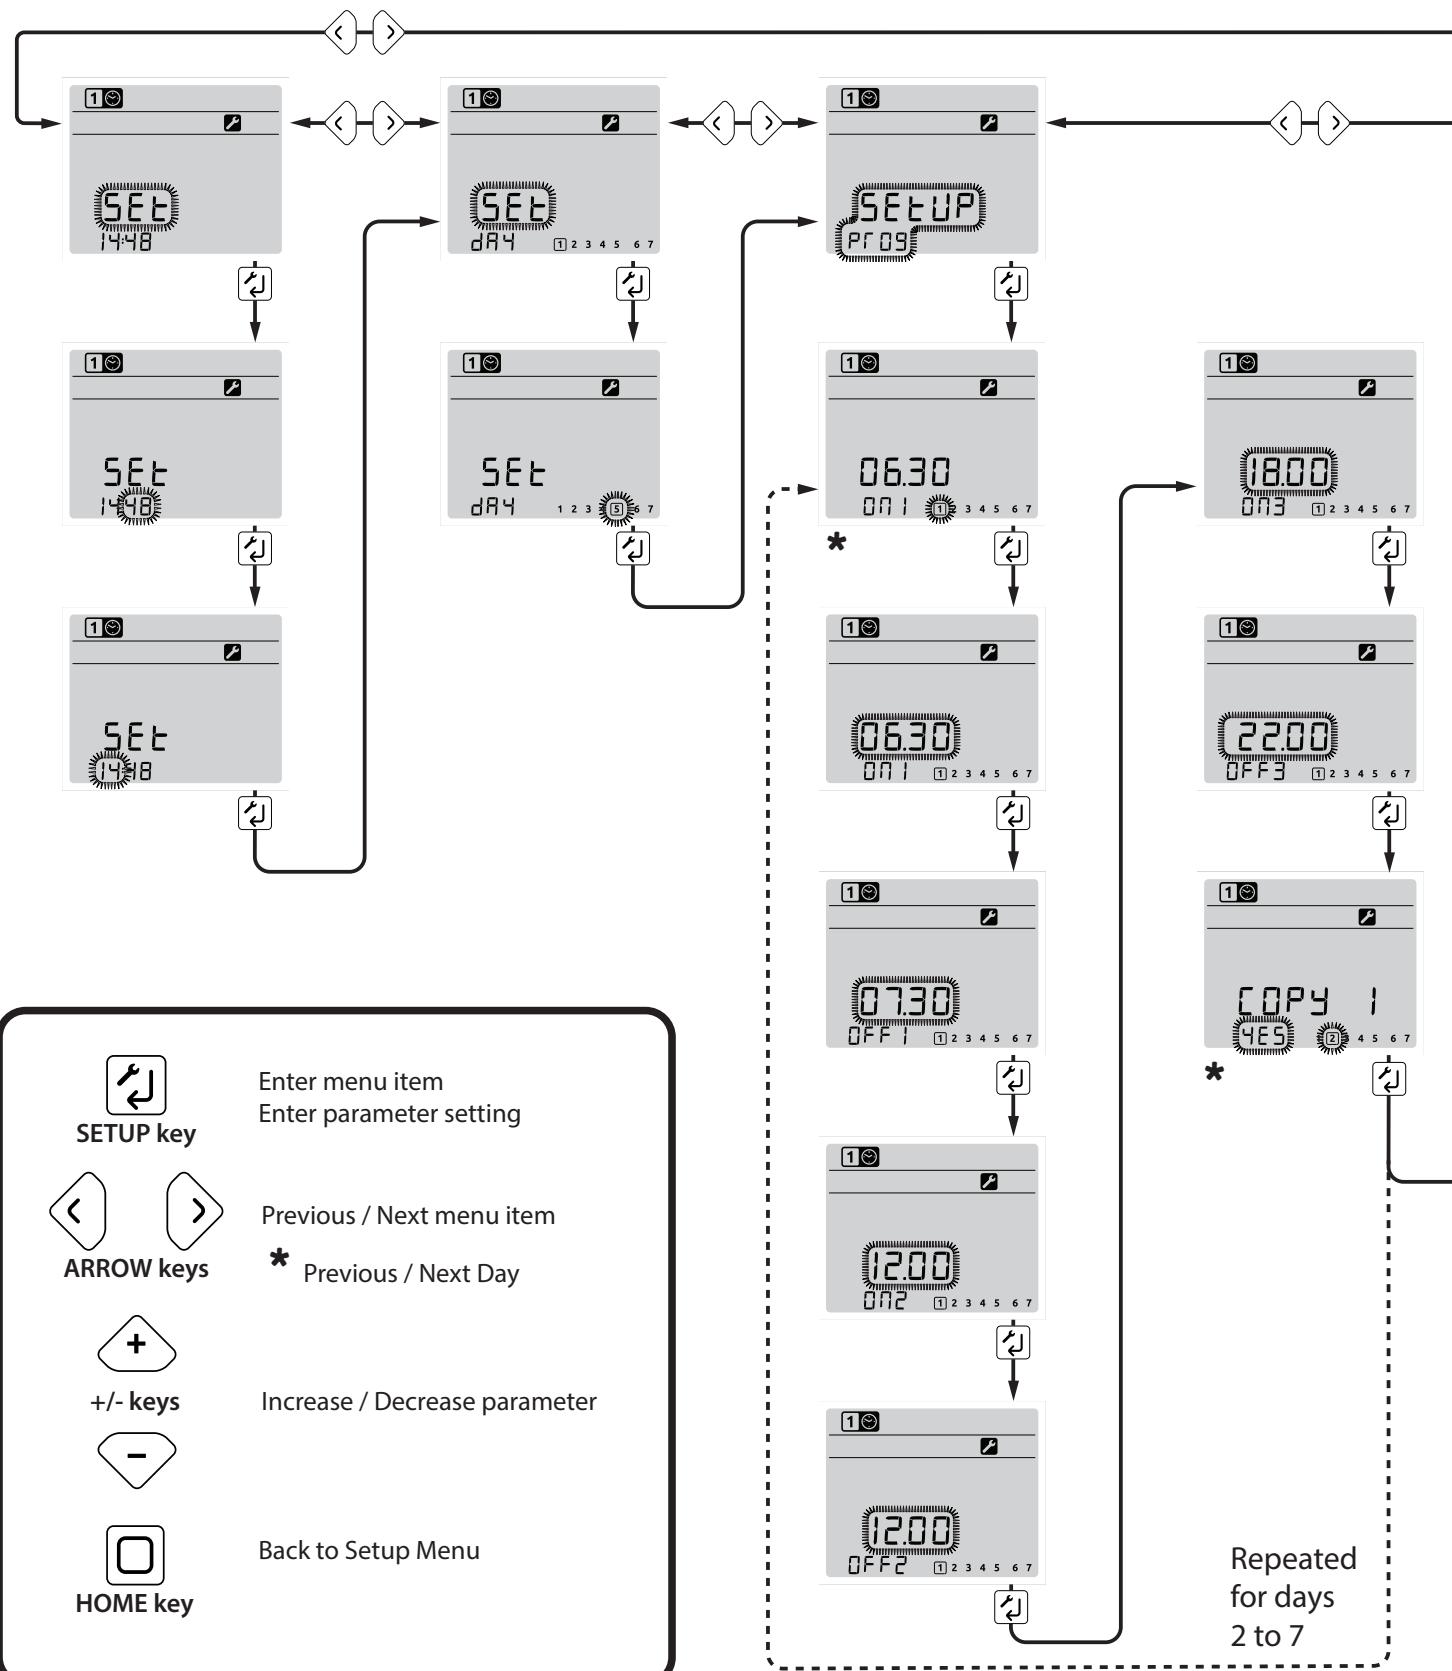

Done



Done is available
after Day 7 Setup
is complete.

In the event of any queries please contact the system installer.

Ensure this booklet is passed to the householder once installation & commissioning of the ventilation system is complete. This Product Manual must be kept in the Home Information Pack.

Installed and Comissioned by:



Important environmental information about this product.

This symbol on this unit or the package, indicates that disposal of this unit after its lifecycle could harm the environment. Do not dispose the unit as unsorted municipal waste; it should be disposed by a specialized company for recycling. This unit should be returned to your distributor or to a local recycling service. Respect the local environmental rules. If any doubt contact your local authorities about waste disposal rules.



MARKETING DIVISION

894 The Crescent, Colchester Business Park, Colchester, Essex, CO4 9YQ United Kingdom
Tel: +44 (0) 1206 713800 **Fax:** +44 (0) 1206 543126
Email: ventsales@titon.co.uk **Web:** www.titon.com